


# Health-Based Standard Violation Iowa Public Water Supplies in 2019

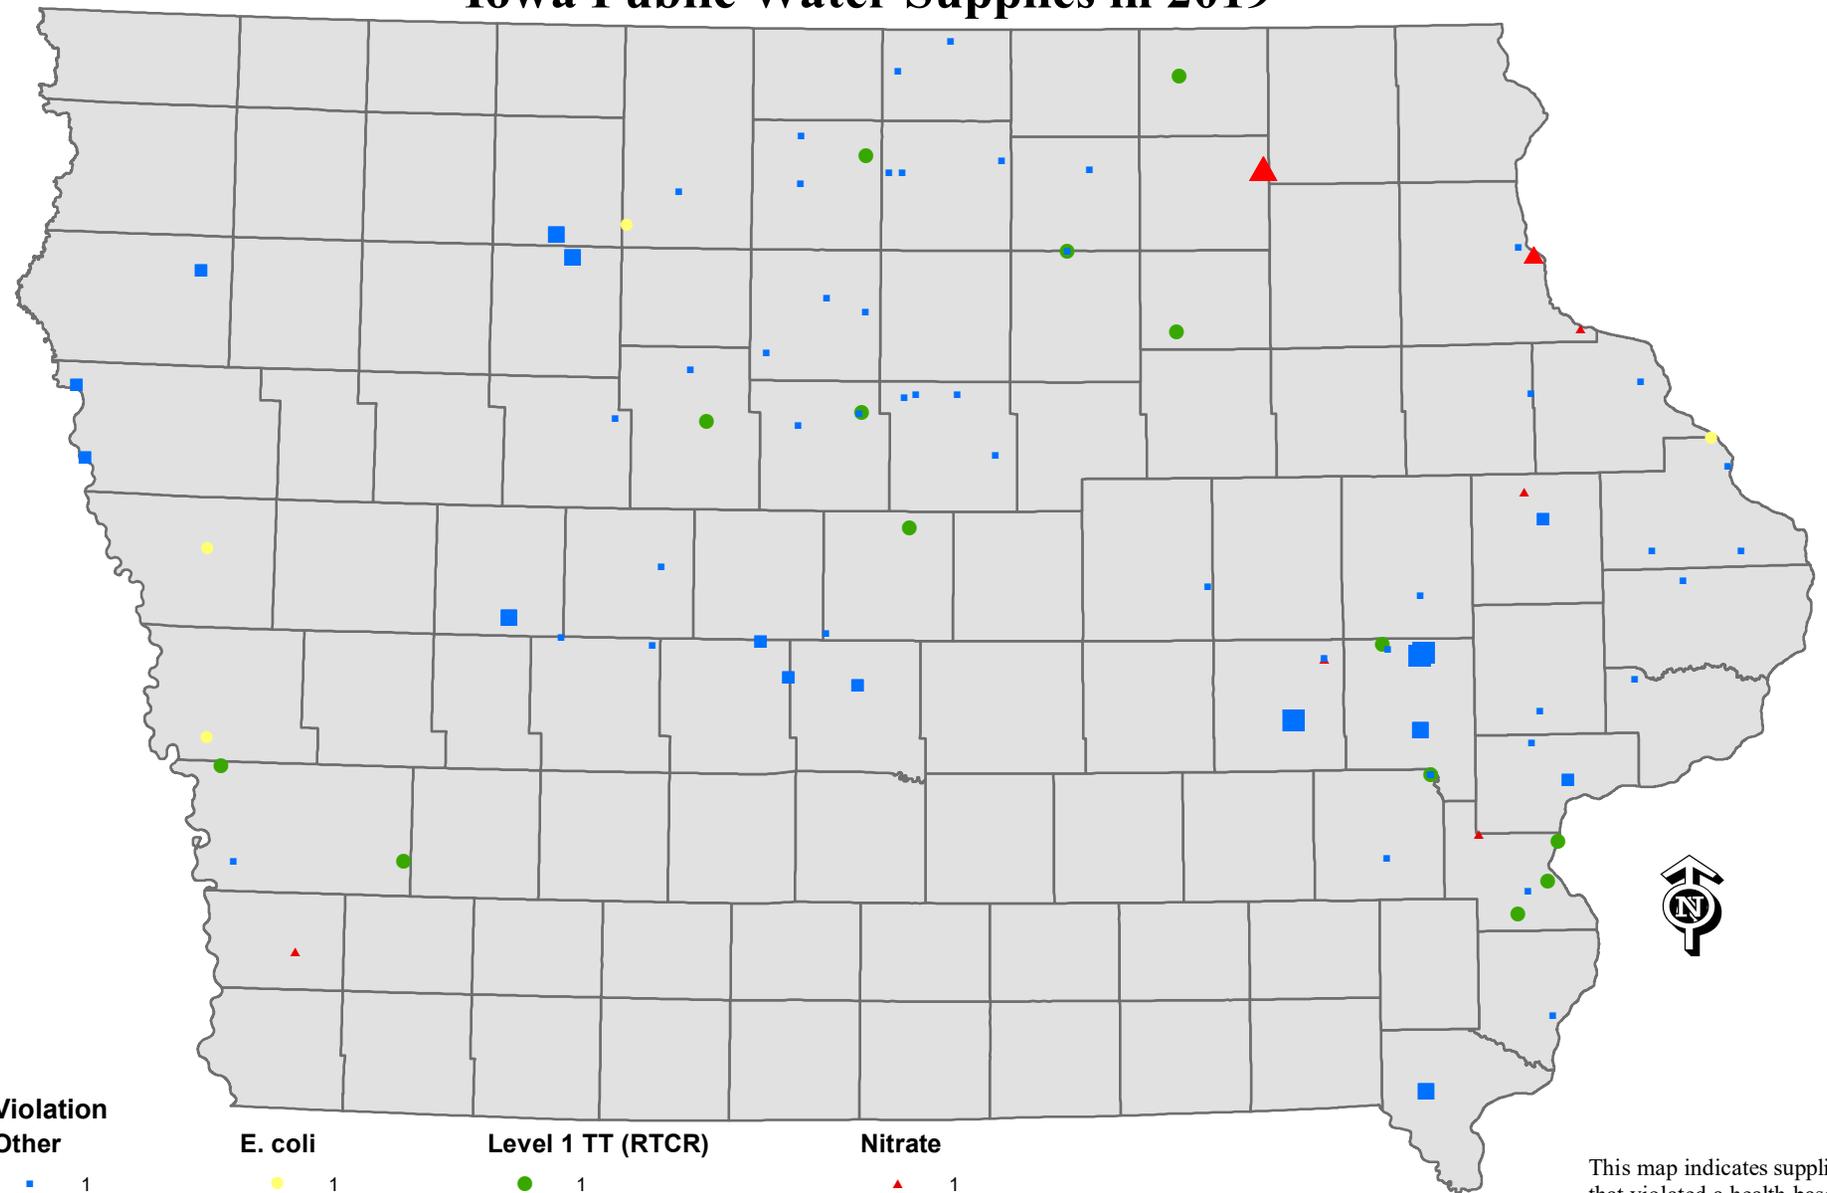

**Violation  
Other**

- 1
- 2
- 3
- 4

**E. coli**

- 1

**Level 1 TT (RTCR)**

- 1

**Nitrate**

- ▲ 1
- ▲ 2 - 3
- ▲ 4

This map indicates supplies that violated a health-based standard in water samples collected either immediately after treatment or in the distribution system.