


Health-Based Standard Violation Iowa Public Water Supplies in 2020

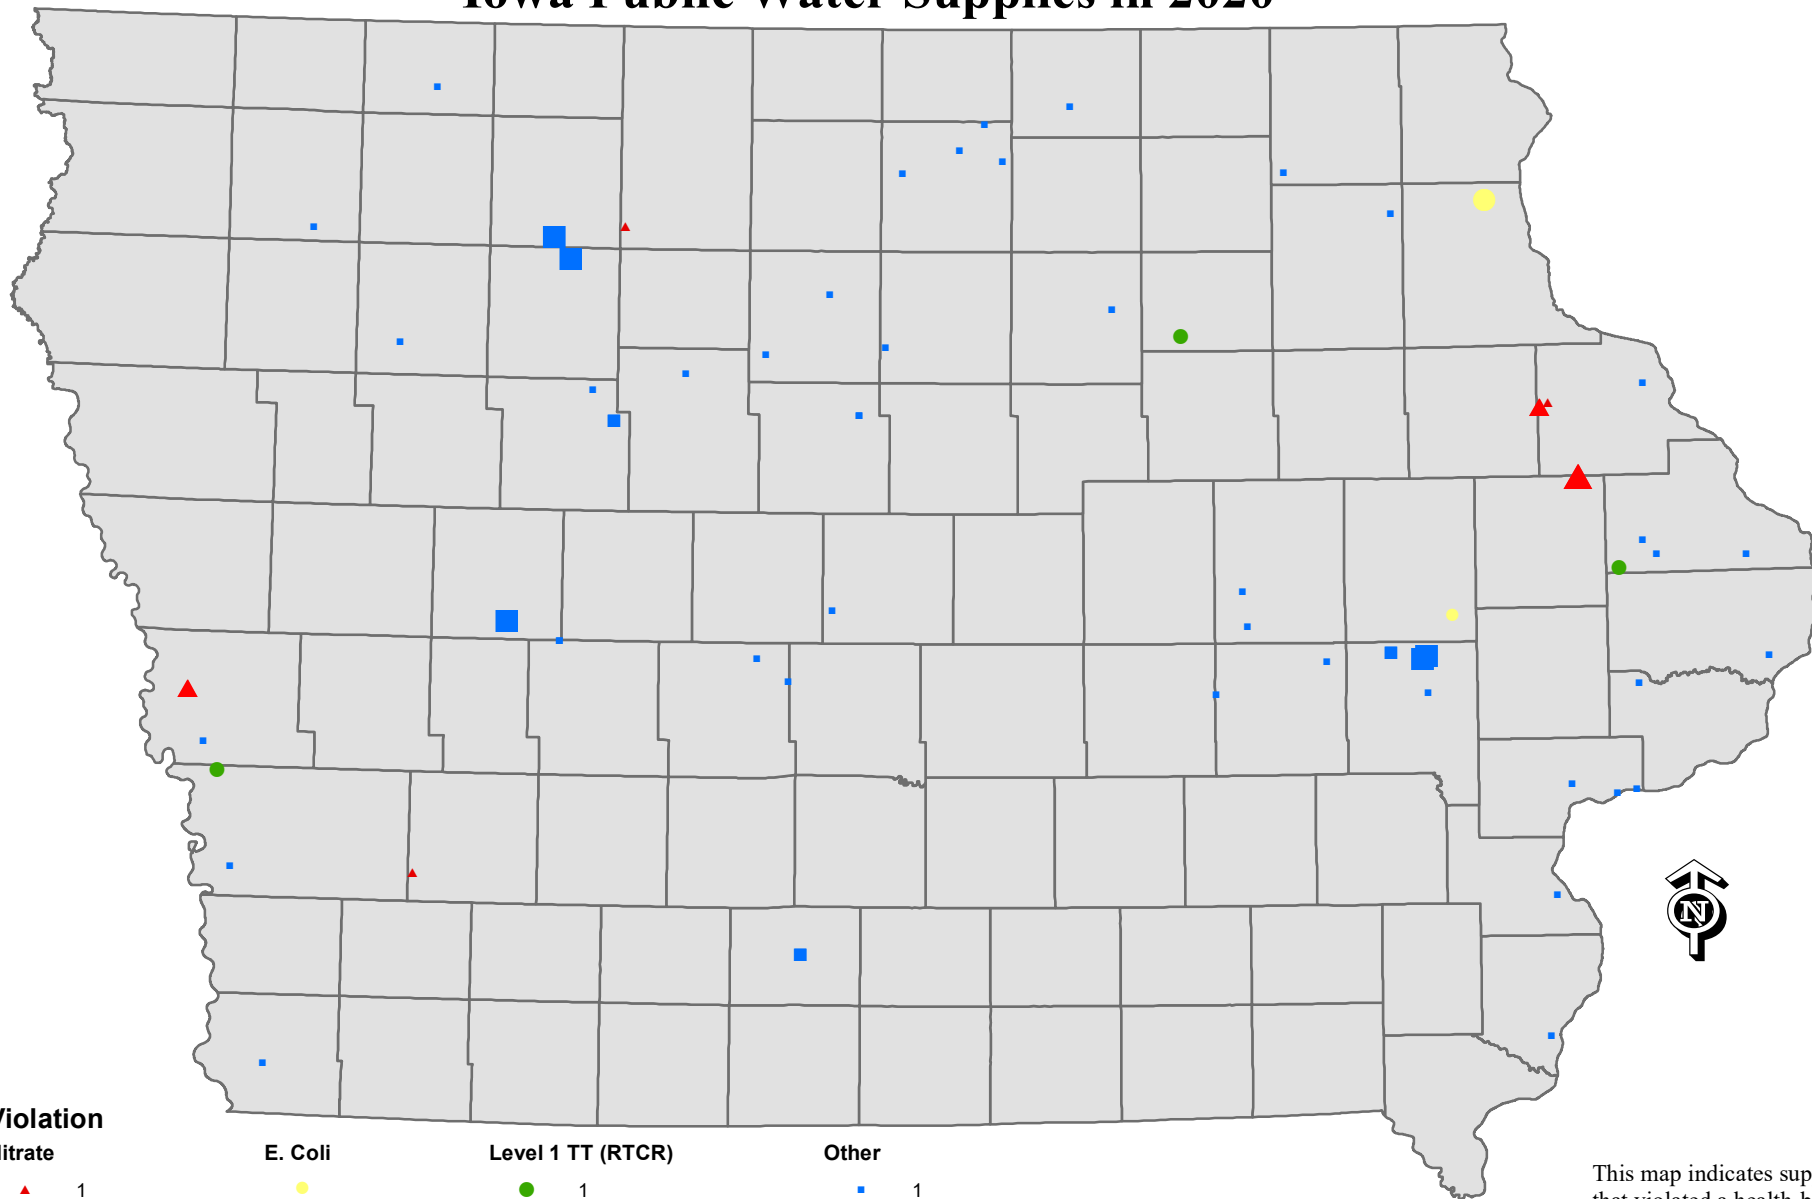

Violation
Nitrate

- ▲ 1
- ▲ 2-3
- ▲ 4-6

E. Coli

- 1
- 2-3

Level 1 TT (RTCR)

- 1

Other

- 1
- 2
- 3
- 4

This map indicates supplies that violated a health-based standard in water samples collected either immediately after treatment or in the distribution system.