


Health-Based Standard Violation Iowa Public Water Supplies in 2022

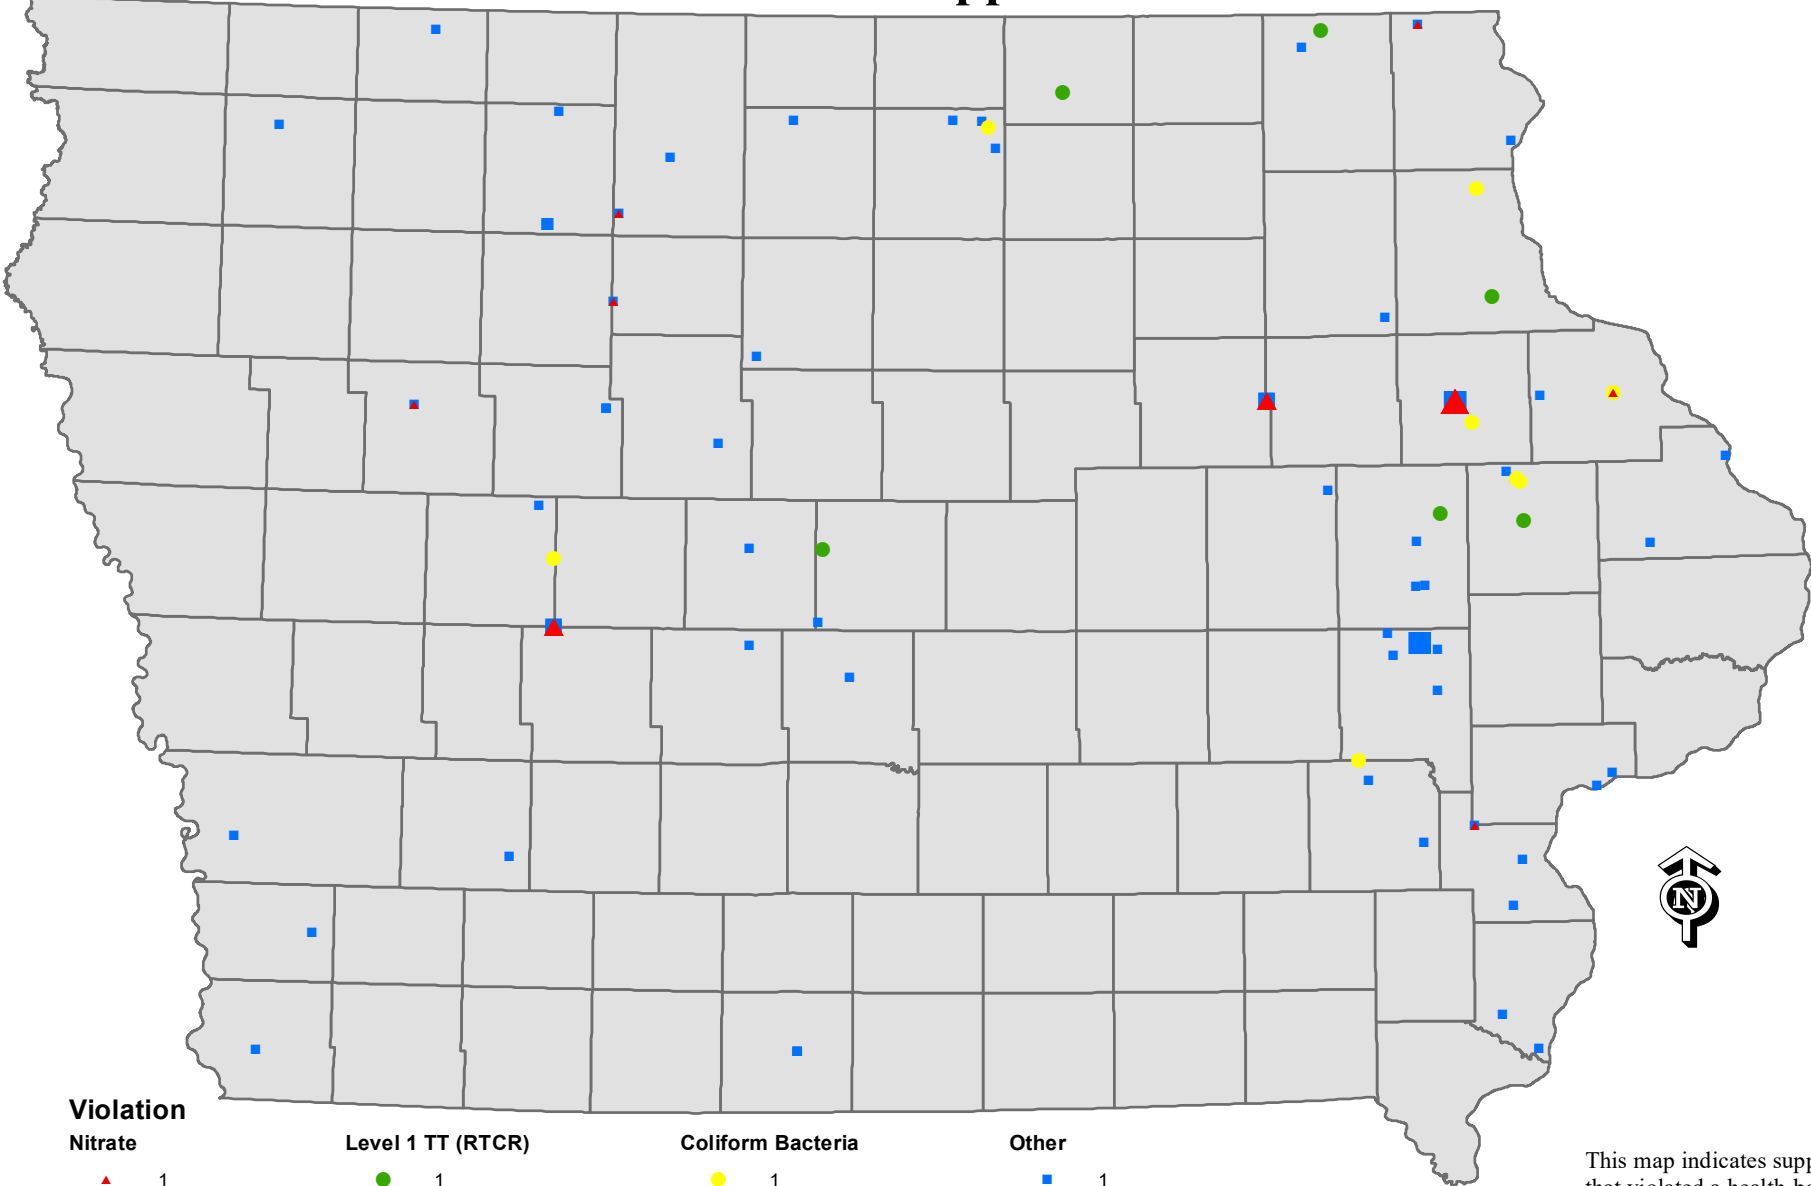

Violation

Nitrate

- ▲ 1
- ▲ 2-3
- ▲ 4-7

Level 1 TT (RTCR)

- 1

Coliform Bacteria

- 1

Other

- 1
- 2
- 3-4
- 5-7

This map indicates supplies that violated a health-based standard in water samples collected either immediately after treatment or in the distribution system.