

**Iowa Department of Natural Resources
Title V Operating Permit**

Name of Permitted Facility: IPL –Burlington Generating Station
Facility Location: 4282 Sullivan Slough Road
Burlington, IA 52601
Air Quality Operating Permit Number: 98-TV-023R2
Expiration Date: March 22, 2017
Permit Renewal Application Deadline: September 22, 2016

EIQ Number: 92-2773
Facility File Number: 29-01-013

Responsible Official

Name: Robert Huschak
Title: Plant Manager
Mailing Address: 4282 Sullivan Slough Road
Burlington, IA 52601
Phone #: 319-758-5301

Permit Contact Person for the Facility

Name: Robert Huschak
Title: Plant Manager
Mailing Address: 4282 Sullivan Slough Road
Burlington, IA 52601
Phone #: 319-758-5301

This permit is issued in accordance with 567 Iowa Administrative Code Chapter 22, and is issued subject to the terms and conditions contained in this permit.

For the Director of the Department of Natural Resources

Douglas A. Campbell, Supervisor of Air Operating Permits Section

Date

Table of Contents

I. Facility Description and Equipment List	4
II. Plant - Wide Conditions	6
III. Emission Point Specific Conditions	9
IV. General Conditions	82
G1. Duty to Comply	
G2. Permit Expiration	
G3. Certification Requirement for Title V Related Documents	
G4. Annual Compliance Certification	
G5. Semi-Annual Monitoring Report	
G6. Annual Fee	
G7. Inspection of Premises, Records, Equipment, Methods and Discharges	
G8. Duty to Provide Information	
G9. General Maintenance and Repair Duties	
G10. Recordkeeping Requirements for Compliance Monitoring	
G11. Evidence used in establishing that a violation has or is occurring.	
G12. Prevention of Accidental Release: Risk Management Plan Notification and Compliance Certification	
G13. Hazardous Release	
G14. Excess Emissions and Excess Emissions Reporting Requirements	
G15. Permit Deviation Reporting Requirements	
G16. Notification Requirements for Sources That Become Subject to NSPS and NESHAP Regulations	
G17. Requirements for Making Changes to Emission Sources That Do Not Require Title V Permit Modification	
G18. Duty to Modify a Title V Permit	
G19. Duty to Obtain Construction Permits	
G20. Asbestos	
G21. Open Burning	
G22. Acid Rain (Title IV) Emissions Allowances	
G23. Stratospheric Ozone and Climate Protection (Title VI) Requirements	
G24. Permit Reopenings	
G25. Permit Shield	
G26. Severability	
G27. Property Rights	
G28. Transferability	
G29. Disclaimer	
G30. Notification and Reporting Requirements for Stack Tests or Monitor Certification	
G31. Prevention of Air Pollution Emergency Episodes	
G32. Contacts List	
V. Appendix A: CAM Plan for Main Plant Boiler (EU 17)	96
VI. Appendix B: Acid Rain Phase II Permit and CAIR Permit	107

Abbreviations

acfm.....	actual cubic feet per minute
CE	control equipment
CEM.....	continuous emission monitor
CFR.....	Code of Federal Regulation
EP	emission point
EU	emission unit
°F	degrees Fahrenheit
EIQ.....	emissions inventory questionnaire
gr./dscf	grains per dry standard cubic foot
IAC.....	Iowa Administrative Code
IDNR.....	Iowa Department of Natural Resources
MVAC.....	motor vehicle air conditioner
NAICS.....	North American Industry Classification System
NSPS.....	new source performance standard
ppmv	parts per million by volume
lb./hr	pounds per hour
lb./MMBtu	pounds per million British thermal units
SCC.....	Source Classification Codes
scfm.....	standard cubic feet per minute
SIC	Standard Industrial Classification
TPY.....	Tons per year
USEPA.....	United States Environmental Protection Agency

Pollutants

PM.....	particulate matter
PM ₁₀	particulate matter ten microns or less in diameter
SO ₂	sulfur dioxide
NO _x	nitrogen oxides
VOC.....	volatile organic compound
CO.....	carbon monoxide
HAP.....	hazardous air pollutant

I. Facility Description and Equipment List

Facility Name: IPL –Burlington Generating Station
 Permit Number: 98-TV-023R2

Facility Description: Electrical Services (SIC 4911)

Equipment List

Emission Point Number	Associated Emission Unit Number(s)	Associated Emission Unit Description	IDNR Construction Permit Number
EP 01	EU 01	Combustion Turbine #1	92-A-569-S3
	EU 01A	Diesel Starter Engine for CT #1	
EP 02	EU 02	Combustion Turbine #2	92-A-570-S3
	EU 02A	Diesel Starter Engine for CT #2	
EP 03	EU 03	Combustion Turbine #3	92-A-571-S3
	EU 03A	Diesel Starter Engine for CT #3	
EP 04	EU 04	Combustion Turbine #4	92-A-572-S3
	EU 04A	Diesel Starter Engine for CT #4	
EP 13	EU 13	Emergency Stationary RICE Generator	05-A-934
EP 16	EU 16	House Heat Boiler	00-A-859
EP 17	EU 17	Main Plant Boiler	93-A-390-S10
EP 18	EU 18	Ash Hydroveyor	N/A
EP 18-1	EU 18-1	Ash Hydroveyor	N/A
EP 19	EU 19	Dry Fly Ash Primary Vacuum Producer	95-A-597-S2
EP 19-1	EU 19-1	Dry Fly Ash Backup Vacuum Producer	97-A-127-S1
EP 20	EU 20	Fly Ash Storage Silo	97-A-126
EP 20A	EU 20A	Fly Ash Unloading	N/A
EP 20B	EU 20B	Fly Ash Loadout – C-Stone Production	N/A
EP 22	EU 22	Fuel Oil Tank (10,000 gallons)	N/A
EP 23	EU 23	Fuel Oil Tank (10,000 gallons)	N/A
EP 25	EU 25	Coal Galley	93-A-386-S2
EP 25A		Coal Galley (Fugitive)	N/A
EP 26	EU 26	Coal Pile	N/A
EP 27	EU 27	Coal Dumper House (Track Hoppers)	93-A-389-S1
EP 28	EU 28	Coal Reclaim Tripper (Fugitive)	N/A
EP 29	EU 29	Barge Hopper	N/A
EP 30	EU 30	Crusher (Fugitive)	N/A
	EU 38	Crusher House Conveyor (Fugitive)	N/A

Equipment List (continued)

Emission Point Number	Associated Emission Unit Number(s)	Associated Emission Unit Description	IDNR Construction Permit Number
EP 31	EU 31	Transfer Equipment (Fugitive)	N/A
	EU 37	Transfer House Conveyor (Fugitive)	N/A
EP 40	EU 40	Reclaim Hopper	93-A-388-S3
EP 40A		Reclaim Hopper (Fugitive)	N/A
EP 44	EU 44	Natural Gas Heater (Indirect Heating)	N/A
EP 100	EU 30	Crusher	93-A-387-S3
	EU 38	Crusher House Conveyor	
	EU 31	Transfer Equipment	
	EU 37	Transfer House Conveyor	

Insignificant Activities Equipment List

Insignificant Emission Unit Number	Insignificant Emission Unit Description
EU 05	Turbine Lube Oil Vent #1
EU 07	Turbine Lube Oil Vent #2
EU 09	Turbine Lube Oil Vent #3
EU 11	Turbine Lube Oil Vent #4
EU 20c	C-Stone Pile & Delivery
EU 39a	Gasoline Storage Tank (300 gallons)
EU 42	Welding Booth
EU 43	Parts Washer

II. Plant-Wide Conditions

Facility Name: IPL – Burlington Generating Station
Permit Number: 98-TV-023R2

Permit conditions are established in accord with 567 Iowa Administrative Code rule 22.108

Permit Duration

The term of this permit is: Five (5) years
Commencing on: March 23, 2012
Ending on: March 22, 2017

Amendments, modifications and reopenings of the permit shall be obtained in accordance with 567 Iowa Administrative Code rules 22.110 - 22.114. Permits may be suspended, terminated, or revoked as specified in 567 Iowa Administrative Code Rules 22.115.

Emission Limits

Unless specified otherwise in the Source Specific Conditions, the following limitations and supporting regulations apply to all emission points at this plant:

Opacity (visible emissions): 40% opacity
Authority for Requirement: 567 IAC 23.3(2)"d"

Sulfur Dioxide (SO₂): 500 parts per million by volume
Authority for Requirement: 567 IAC 23.3(3)"e"

Particulate Matter:

No person shall cause or allow the emission of particulate matter from any source in excess of the emission standards specified in this chapter, except as provided in 567 – Chapter 24. For sources constructed, modified or reconstructed after July 21, 1999, the emission of particulate matter from any process shall not exceed an emission standard of 0.1 grain per dry standard cubic foot of exhaust gas, except as provided in 567 – 21.2(455B), 23.1(455B), 23.4(455B) and 567 – Chapter 24.

For sources constructed, modified or reconstructed prior to July 21, 1999, the emission of particulate matter from any process shall not exceed the amount determined from Table I, or amount specified in a permit if based on an emission standard of 0.1 grain per standard cubic foot of exhaust gas or established from standards provided in 23.1(455B) and 23.4(455B).

Authority for Requirement: 567 IAC 23.3(2)"a" (as revised 7/21/1999)

Fugitive Dust: Attainment and Unclassified Areas - No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction

haul road to be used, constructed, altered repaired or demolished, with the exception of farming operations or dust generated by ordinary travel on unpaved public roads, without taking reasonable precautions to prevent particulate matter in quantities sufficient to create a nuisance, as defined in Iowa Code section 657.1, from becoming airborne. All persons, with the above exceptions, shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate. The highway authority shall be responsible for taking corrective action in those cases where said authority has received complaints of or has actual knowledge of dust conditions which require abatement pursuant to this subrule. Reasonable precautions may include, but not limited to, the following procedures.

1. Use, where practical, of water or chemicals for control of dusts in the demolition of existing buildings or structures, construction operations, the grading of roads or the clearing of land.
2. Application of suitable materials, such as but not limited to asphalt, oil, water or chemicals on unpaved roads, material stockpiles, race tracks and other surfaces which can give rise to airborne dusts.
3. Installation and use of containment or control equipment, to enclose or otherwise limit the emissions resulting from the handling and transfer of dusty materials, such as but not limited to grain, fertilizers or limestone.
4. Covering at all times when in motion, open-bodied vehicles transporting materials likely to give rise to airborne dusts.
5. Prompt removal of earth or other material from paved streets or to which earth or other material has been transported by trucking or earth-moving equipment, erosion by water or other means.

Authority for Requirement: 567 IAC 23.3(2)"c"

Compliance Plan

The owner/operator shall comply with the applicable requirements listed below. The compliance status is based on information provided by the applicant.

Unless otherwise noted in Section III of this permit, IPL – Burlington Generating Station is in compliance with all applicable requirements and shall continue to comply with all such requirements. For those applicable requirements which become effective during the permit term, IPL – Burlington Generating Station shall comply with such requirements in a timely manner.

Authority for Requirement: 567 IAC 22.108(15)

40 CFR 63 Subpart YYYY Requirements

This facility is subject to National Emission Standard for Hazardous Air Pollutants for Stationary Combustion Turbines – 40 CFR 63 subpart YYYY per 40 CFR 63.6090, and the affected units are EU 01, EU 02, EU 03, and EU 04. However, per 40 CFR 63.6090(b)(4), those existing combustion turbines (which existed before January 14, 2003 per 40 CFR 63.6090(a)(1)) do not have to meet the requirements of subpart YYYY and subpart A of part 63.

Authority for Requirement: 40 CFR 63 Subpart YYYY

40 CFR 63 Subpart DDDDD Requirements

House Heat Boiler (EU16) and Natural Gas Heater (EU 44) are of the source category affected by the following federal regulation: National Emission Standards for Hazardous Air Pollutants for Major Sources: Industrial, Commercial, and Institutional Boilers and Process Heaters [40 CFR Part 63 Subpart DDDDD].

Authority for Requirement: 40 CFR 63 Subpart DDDDD

40 CFR 63 Subpart UUUUU Requirements

Main Plant Boiler (EU 17) is of the source category affected by the following federal regulation: National Emission Standards for Hazardous Air Pollutants from Coal- and Oil-fired Electric Utility Steam Generating Units [40 CFR Part 63 Subpart UUUUU].

Authority for Requirement: 40 CFR 63 Subpart UUUUU

40 CFR 63 Subpart ZZZZ Requirements

Emergency Stationary RICE Generator (EU 13) and Diesel Starter Engines (EU 01A, 02A, 03A, and 04A) are of the source category affected by the following federal regulation: National Emission Standards for Hazardous Air Pollutants for Stationary Reciprocating Internal Combustion Engines (RICE NESHAP) [40 CFR Part 63, Subpart ZZZZ].

Authority for Requirement: 40 CFR Part 63 Subpart ZZZZ

III. Emission Point-Specific Conditions

Facility Name: IPL – Burlington Generating Station
Permit Number: 98-TV-023R2

Emission Point ID Number: EP 01

Associated Equipment

Associated Emission Unit ID Numbers: EU 01 and EU 01A

Emission Unit vented through this Emission Point: EU 01
Emission Unit Description: Combustion Turbine #1
Raw Material/Fuel: Natural Gas and Fuel Oil
Rated Capacity: 288 MMBtu/hr

Emission Unit vented through this Emission Point: EU 01A
Emission Unit Description: Diesel Starter Engine for CT #1
Raw Material/Fuel: Fuel Oil
Rated Capacity: 40 gal/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40% ⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d"

Iowa DNR PSD Construction Permit 92-A-569-S3

⁽¹⁾ An exceedence of the indicator opacity of no visible emissions will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: PM₁₀

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Pollutant: Particulate Matter (PM)
Emission Limits for Natural Gas only: 4.8 lb/hr
Emission Limits for Fuel Oil only: 12.5 lb/hr
Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits for Natural Gas only: 1.8 lb/hr
Emission Limits for Fuel Oil only: 8.8 lb/hr
Annual Emission Limits for Natural Gas and Fuel Oil combined: 2.81 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: 95.0 lb/hr, 41.33 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Pollutant: Volatile Organic Compounds (VOCs)
Emission Limits: 13.9 lb/hr, 6.05 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Pollutant: Carbon Monoxide (CO)
Emission Limits: 38.4 lb/hr, 16.70 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Operating Limits:

- A. This turbine shall be fired by natural gas or fuel oil #1 or #2 only.
 - B. This turbine shall be operated a maximum of 7 hours and 15 minutes per day when fired by fuel oil.
 - C. This turbine shall be operated a maximum of 200 hours per rolling 12 month period when fired by fuel oil.
 - D. This turbine shall be operated a maximum of 850 hours per rolling 12 month period.
 - E. The sulfur content of any fuel fired in this turbine shall not exceed 0.5% by weight.
 - F. The inlet fogger on this turbine is allowed to operate anytime the turbine is in operation.
- Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Record the number of hours this turbine is fired by each fuel. Calculate and record daily, monthly and rolling 12-month totals.
- B. Record the sulfur content of any fuel fired in this turbine, in weight percent.
- C. Determine compliance with the NO_x and SO₂ limits cited above by applying the latest emission factors with the amount of fuel consumed for each turbine. Calculate and record monthly and 12 month rolling totals.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3

NSPS Subpart GG Requirements:

This combustion turbine is subject to Subpart A (General Provisions) and Subpart GG (Standards of Performance for Stationary Gas Turbines) of the New Source Performance Standards (NSPS) with respect to the testing of fuels for sulfur content as required by 40 CFR 60.334 and 60.335.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-569-S3
567 IAC 23.1(2)"aa"
40 CFR 60 subpart GG

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 37

Stack Opening (inches): 96×120

Exhaust Temperature (°F): 960

Exhaust Flowrate (scfm): 144,350

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 92-A-569-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 02

Associated Equipment

Associated Emission Unit ID Numbers: EU 02 and EU 02A

Emission Unit vented through this Emission Point: EU 02
Emission Unit Description: Combustion Turbine #2
Raw Material/Fuel: Natural Gas and Fuel Oil
Rated Capacity: 288 MMBtu/hr

Emission Unit vented through this Emission Point: EU 02A
Emission Unit Description: Diesel Starter Engine for CT#2
Raw Material/Fuel: Fuel Oil
Rated Capacity: 40 gal/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40% ⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d"

Iowa DNR PSD Construction Permit 92-A-570-S3

⁽¹⁾ An exceedence of the indicator opacity of no visible emissions will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: PM₁₀

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

Pollutant: Particulate Matter

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR Construction Permit 92-A-570-S3

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits for Natural Gas only: 1.8 lb/hr
Emission Limits for Fuel Oil only: 8.8 lb/hr
Annual Emission Limits for Natural Gas and Fuel Oil combined: 2.81 tons/yr
Authority for Requirement: Iowa DNR Construction Permit 92-A-570-S3

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: 95.0 lb/hr, 41.33 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

Pollutant: Volatile Organic Compounds (VOCs)
Emission Limits: 13.9 lb/hr, 6.05 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

Pollutant: Carbon Monoxide (CO)
Emission Limits: 38.4 lb/hr, 16.70 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Operating Limits:

- A. This turbine shall be fired by natural gas or fuel oil #1 or #2 only.
 - B. This turbine shall be operated a maximum of 7 hours and 15 minutes per day when fired by fuel oil.
 - C. This turbine shall be operated a maximum of 200 hours per rolling 12 month period when fired by fuel oil.
 - D. This turbine shall be operated a maximum of 850 hours per rolling 12 month period.
 - E. The sulfur content of any fuel fired in this turbine shall not exceed 0.5% by weight.
 - F. The inlet fogger on this turbine is allowed to operate anytime the turbine is in operation.
- Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Record the number of hours this turbine is fired by each fuel. Calculate and record daily, monthly and rolling 12 month totals.
- B. Record the sulfur content of any fuel fired in this turbine, in weight percent.
- C. Determine compliance with the NO_x and SO₂ limits cited above by applying the latest emission factors with the amount of fuel consumed for each turbine. Calculate and record monthly and 12 month rolling totals.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

NSPS Subpart GG Requirements:

This combustion turbine is subject to Subpart A (General Provisions) and Subpart GG (Standards of Performance for Stationary Gas Turbines) of the New Source Performance Standards (NSPS) with respect to the testing of fuels for sulfur content as required by 40 CFR 60.334 and 60.335.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3
567 IAC 23.1(2)"aa"
40 CFR 60 subpart GG

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 37

Stack Opening (inches): 96×120

Exhaust Temperature (°F): 960

Exhaust Flowrate (scfm): 144,350

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-570-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 03

Associated Equipment

Associated Emission Unit ID Numbers: EU 03 and EU 03A

Emission Unit vented through this Emission Point: EU 03
Emission Unit Description: Combustion Turbine #3
Raw Material/Fuel: Natural Gas and Fuel Oil
Rated Capacity: 288 MMBtu/hr

Emission Unit vented through this Emission Point: EU 03A
Emission Unit Description: Diesel Starter Engine for CT #3
Raw Material/Fuel: Fuel Oil
Rated Capacity: 40 gal/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40% ⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d"

Iowa DNR PSD Construction Permit 92-A-571-S3

⁽¹⁾ An exceedence of the indicator opacity of no visible emissions will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: PM₁₀

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Pollutant: Particulate Matter

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits for Natural Gas only: 1.8 lb/hr
Emission Limits for Fuel Oil only: 8.8 lb/hr
Annual Emission Limits for Natural Gas and Fuel Oil combined: 2.81 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: 95.0 lb/hr, 41.33 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Pollutant: Volatile Organic Compounds (VOCs)
Emission Limits: 13.9 lb/hr, 6.05 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Pollutant: Carbon Monoxide (CO)
Emission Limits: 38.4 lb/hr, 16.70 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Operating Limits:

- A. This turbine shall be fired by natural gas or fuel oil #1 or #2 only.
 - B. This turbine shall be operated a maximum of 7 hours and 15 minutes per day when fired by fuel oil.
 - C. This turbine shall be operated a maximum of 200 hours per rolling 12 month period when fired by fuel oil.
 - D. This turbine shall be operated a maximum of 850 hours per rolling 12 month period.
 - E. The sulfur content of any fuel fired in this turbine shall not exceed 0.5% by weight.
 - F. The inlet fogger on this turbine is allowed to operate anytime the turbine is in operation.
- Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Record the number of hours this turbine is fired by each fuel. Calculate and record daily, monthly and rolling 12 month totals.
- B. Record the sulfur content of any fuel fired in this turbine, in weight percent.
- C. Determine compliance with the NO_x and SO₂ limits cited above by applying the latest emission factors with the amount of fuel consumed for each turbine. Calculate and record monthly and 12 month rolling totals.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

NSPS Subpart GG Requirements:

This combustion turbine is subject to Subpart A (General Provisions) and Subpart GG (Standards of Performance for Stationary Gas Turbines) of the New Source Performance Standards (NSPS) with respect to the testing of fuels for sulfur content as required by 40 CFR 60.334 and 60.335.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3
567 IAC 23.1(2)"aa"
40 CFR 60 subpart GG

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 37

Stack Opening (inches): 96×120

Exhaust Temperature (°F): 960

Exhaust Flowrate (scfm): 144,350

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-571-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 04

Associated Equipment

Associated Emission Unit ID Numbers: EU 04 and EU 04A

Emission Unit vented through this Emission Point: EU 04
Emission Unit Description: Combustion Turbine #4
Raw Material/Fuel: Natural Gas and Fuel Oil
Rated Capacity: 288 MMBtu/hr

Emission Unit vented through this Emission Point: EU 04A
Emission Unit Description: Diesel Starter Engine for CT #4
Raw Material/Fuel: Fuel Oil
Rated Capacity: 40 gal/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40% ⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d"

Iowa DNR PSD Construction Permit 92-A-572-S3

⁽¹⁾ An exceedence of the indicator opacity of no visible emissions will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: PM₁₀

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Pollutant: Particulate Matter

Emission Limits for Natural Gas only: 4.8 lb/hr

Emission Limits for Fuel Oil only: 12.5 lb/hr

Annual Emission Limits for Natural Gas and Fuel Oil combined: 4.32 tons/yr

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits for Natural Gas only: 1.8 lb/hr
Emission Limits for Fuel Oil only: 8.8 lb/hr
Annual Emission Limits for Natural Gas and Fuel Oil combined: 2.81 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: 95.0 lb/hr, 41.33 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Pollutant: Volatile Organic Compounds (VOCs)
Emission Limits: 13.9 lb/hr, 6.05 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Pollutant: Carbon Monoxide (CO)
Emission Limits: 38.4 lb/hr, 16.70 tons/yr
Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Operating Limits:

- A. This turbine shall be fired by natural gas or fuel oil #1 or #2 only.
 - B. This turbine shall be operated a maximum of 7 hours and 15 minutes per day when fired by fuel oil.
 - C. This turbine shall be operated a maximum of 200 hours per rolling 12 month period when fired by fuel oil.
 - D. This turbine shall be operated a maximum of 850 hours per rolling 12 month period.
 - E. The sulfur content of any fuel fired in this turbine shall not exceed 0.5% by weight.
 - F. The inlet fogger on this turbine is allowed to operate anytime the turbine is in operation.
- Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Record the number of hours this turbine is fired by each fuel. Calculate and record daily, monthly and rolling 12 month totals.
- B. Record the sulfur content of any fuel fired in this turbine, in weight percent.
- C. Determine compliance with the NO_x and SO₂ limits cited above by applying the latest emission factors with the amount of fuel consumed for each turbine. Calculate and record monthly and 12 month rolling totals.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

NSPS Subpart GG Requirements:

This combustion turbine is subject to Subpart A (General Provisions) and Subpart GG (Standards of Performance for Stationary Gas Turbines) of the New Source Performance Standards (NSPS) with respect to the testing of fuels for sulfur content as required by 40 CFR 60.334 and 60.335.

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3
567 IAC 23.1(2)"aa"
40 CFR 60 subpart GG

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 37

Stack Opening (inches): 96×120

Exhaust Temperature (°F): 960

Exhaust Flowrate (scfm): 144,350

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR PSD Construction Permit 92-A-572-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 13

Associated Equipment

Associated Emission Unit ID Number: EU 13

Emission Unit vented through this Emission Point: EU 13
Emission Unit Description: Emergency Stationary RICE Generator
Raw Material/Fuel: Fuel Oil
Rated Capacity: 602 bhp (400 kW)

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40% ⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d"

Iowa DNR Construction Permit 05-A-934

⁽¹⁾ An exceedence of the indicator opacity of 20% will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: PM₁₀

Emission Limits: 0.57 lb/hr

Authority for Requirement: Iowa DNR Construction Permit 05-A-934

Pollutant: Particulate Matter

Emission Limits: 0.1 gr/dscf, 0.57 lb/hr

Authority for Requirement: 567 IAC 23.3(2)"a"

Iowa DNR Construction Permit 05-A-934

Pollutant: Sulfur Dioxide (SO₂)

Emission Limits: 2.5 lb/MMBtu

Authority for Requirement: 567 IAC 23.3(3)"b"(2)

Iowa DNR Construction Permit 05-A-934

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Hours of operation:

1. This emergency generator shall not operate more than 876 hours per rolling twelve-month period and only for emergency situations.

Authority for Requirement: Iowa DNR Construction Permit 05-A-934

Process throughput:

1. The Sulfur content of the fuel shall not exceed 0.5% by weight.

Authority for Requirement: Iowa DNR Construction Permit 05-A-934

Reporting & Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

1. The owner or operator shall record the amount of time this generator operates each time this generator is operated. Calculate a monthly and rolling twelve-month total.
2. The owner or operator shall provide a vendor certification of the Sulfur content of the fuel oil used in this generator.

Authority for Requirement: Iowa DNR Construction Permit 05-A-934

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 10.33

Stack Opening (inches, dia.): 6

Exhaust Temperature (°F): 1004

Exhaust Flowrate (scfm): 1,072

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 05-A-934

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 16

Associated Equipment

Associated Emission Unit ID Number: EU 16

Emission Unit vented through this Emission Point: EU 16

Emission Unit Description: House Heat Boiler

Raw Material/Fuel: Natural Gas

Rated Capacity: 15 MMBtu/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 40%⁽¹⁾

Authority for Requirement: 567 IAC 23.3(2)"d" (Iowa DNR Construction Permit 00-A-859)

⁽¹⁾ An exceedence of the indicator opacity of 25% will require the owner/operator to promptly investigate the emission unit and make corrections to operations or equipment associated with the exceedence. If exceedences continue after the corrections, the DNR may require additional proof to demonstrate compliance (e.g., stack testing).

Pollutant: Particulate Matter (PM)

Emission Limit(s): 0.6 lb/MMBtu

Authority for Requirement: 567 IAC 23.3(2)"b" (Iowa DNR Construction Permit 00-A-859)

Pollutant: Sulfur Dioxide (SO₂)

Emission Limit(s): 500 ppmv

Authority for Requirement: 567 IAC 23.3(3)"e" (Iowa DNR Construction Permit 00-A-859)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirement:

This emission unit is subject to Subpart A (General Provisions) and Subpart Dc (Standards of Performance for Small Industrial-Commercial-Institutional Steam Generating Units) of the New Source Performance Standards (NSPS). The specific requirements are included in the Operating Limits and Reporting & Record Keeping. These sections include the alternative (i.e., reduced) recordkeeping and reporting requirements allowed by EPA Region VII. Failure to specifically include all of the

requirements of the NSPS in this permit does not relieve the owner or operator of those requirements.

Operating Limits:

- A. This emission unit shall use natural gas only.
- B. The owner or operator shall send a certification to the Department stating that this emission unit will burn only natural gas.

Reporting & Record Keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. The amount of fuel used on a monthly basis.
- B. A copy of all excess emission reports required for Subpart Dc. Per the reduced recordkeeping for Subpart Dc the facility may report excess emissions (or lack thereof) on an annual frequency. It should be noted that the facility is also required to orally notify the DNR field office of excess emissions within 8 hours and submit a written report within 7 days.

Authority for Requirement: Iowa DNR Construction Permit 00-A-859
567 IAC 23.1(2)"III"
40 CFR 60 subpart Dc

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 171.8
Stack Opening (inches, dia.): 23
Exhaust Temperature (°F): 500
Exhaust Flowrate (scfm): 32,000
Discharge Style: Vertical Unobstructed
Authority for Requirement: Iowa DNR Construction Permit 00-A-859

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 17

Associated Equipment

Associated Emission Unit ID Number: EU 17
Emissions Control Equipment ID Numbers: CE 01 and CE 45
Emissions Control Equipment Description: Electrostatic Precipitator, Sulfur Burner
Continuous Emissions Monitors ID Numbers ME1-1, ME1-2, ME1-3, ME1-4, and ME1-5

Emission Unit vented through this Emission Point: EU 17
Emission Unit Description: Main Plant Boiler, Dry-Bottom Pulverized Coal T-Fired,
with Low NOx Burners
Raw Material/Fuel: Coal, Fuel Oil, and Natural Gas
Rated Capacity: 2077 MMBtu/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 40%
Authority for Requirement: 567 IAC 23.3(2)"d"
Iowa DNR Construction Permit 93-A-390-S10

Pollutant: Particulate Matter
Emission Limits: 0.8 lb/MMBtu
Authority for Requirement: 567 IAC 23.3(2)"b"(1)
Iowa DNR Construction Permit 93-A-390-S10

Pollutant: PM₁₀
Emission Limits: 0.559 lb/MMBtu expressed as the average of 3 runs,
1,161.0 lb/hr expressed as the average of 3 runs, and
5,085.4 tons/yr expressed as a 12-month rolling total
Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits: 5.032 lb/MMBtu based on a 3-hour rolling average,
9,882.0 lb/hr expressed as the average of 3 runs, and
43,283.2 tons/yr expressed as a 12-month rolling total
Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits: Sulfur Dioxide Allowances
Authority for Requirement: 567 IAC 22.108(7) (Attached Phase II Acid Rain Permit)

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: 0.44 lb/MMBtu based on a 30-day rolling average,
885.0 lb/hr expressed as the average of 3 runs, and
3,876.3 tons/yr expressed as a 12-month rolling total
Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Pollutant: Nitrogen Oxides (NO_x)
Emission Limits: See attached Phase II Permit
Authority for Requirement: 567 IAC 22.125(4) (Attached Phase II Acid Rain Permit)
40 CFR Part 76

Pollutant: Carbon Monoxide (CO)
Emission Limits: 0.102 lb/MMBtu expressed as the average of 3 one-hour test runs,
200.3 lb/hr expressed as the average of 3 runs, and
877.3 tons/yr expressed as a 12-month rolling total
Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Operating Limits and Work Practice Standards:

- A. The control equipment associated with the Main Plant Boiler shall be inspected and maintained according to the CAM Plan specifications, and the manufacturer's specifications and maintenance schedule.
- B. This unit is subject to IAC 25.3, Mercury emissions testing and monitoring. The owner or operator must comply with the testing and reporting requirements in IAC 25.3(1), 25.3(2), 25.3(3) and 25.3(4).
- C. NSPS subpart Da applicability for this unit for NO_x shall be determined by using CEM data before and after the proposed physical modifications. A consecutive two month period (July and August 2009 and 2010) shall be used to generate the data points. Emission rates may be adjusted for load for comparison purposes. Methods outlined in Appendix C of 40 CFR 60 shall be used to determine if there is any increase in the hourly emission rate. The final NSPS applicability shall be made by the regulating authorities.
- D. NSPS subpart Da applicability for this unit for PM shall be determined by using the most recent representative stack test data before and after the proposed physical modifications. Emission rates may be adjusted for load for comparison purposes. Methods outlined in Appendix C of 40 CFR 60 shall be used to determine if there is any increase in the hourly emission rate. The final NSPS applicability shall be made by the regulating authorities.

- E. To maintain Construction Project 09-496 as a minor project for Prevention of Significant Deterioration (PSD), the owner or operator shall have the following requirements after the physical modifications permitted by this project:
- a. Construction Project 09-496 includes physical changes to the following emission unit: Boiler #1 (EU17). These changes include the replacement of a portion of the rear water wall hanger tubes, platen superheater crown seals replacement and other projects listed in the application dated 11/20/09.
 - b. A report to the department shall be submitted within 60 days after the end of the each year setting out the unit's annual emissions during the calendar year that preceded submission of the report pursuant to 567 IAC 33.3 (18)"f" (6). This report is required for the 5 years following the date of start of operation of this project.

Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Reporting & Record Keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Record the amount of each fuel fired in this boiler.
- B. Record the amount of oil used per month, in gallons. Calculate and record monthly and 12-month rolling totals.
- C. Whenever coal and oil are used simultaneously, the owner or operator shall maintain a record of the ratio of oil to coal used.
- D. The owner or operator must notify the Department in writing of the results of the preliminary NSPS applicability test described in 14.C. in IDNR construction permit 93-A-390-S10 by December 1, 2010. (Note: this requirement has been completed.)
- E. The owner or operator must notify the Department in writing of the results of the preliminary NSPS applicability test described in 14.D. in IDNR construction permit 93-A-390-S10 within 90 days of the completion of the PM stack test required by this permit. (Note: this requirement has been completed.)
- F. For the purposes of maintaining Construction Project 09-496 as a minor project for Prevention of Significant Deterioration (PSD), the owner or operator shall have the following monitoring conditions for a period five (5) years from the date of start of operation (start-up date) of Boiler #1 after the physical modifications:
 - a. Record the date Boiler #1 starts operation after the physical modifications.
 - b. Record annually the sum of the actual PM, PM10, VOC, sulfuric acid mist, fluorides, CO, NO_x, lead and SO₂ emissions from Boiler #1 in tons per year on a calendar-year basis.
 - c. Record annually the ton per year value of the actual emissions minus the baseline actual emissions for PM, PM10, VOC, CO, NO_x, sulfuric acid mist, fluorides, lead and SO₂.
- G. Maintain a record of all inspections/maintenance and any action resulting from the inspection/maintenance of control equipment associated with the Main Plant Boiler.

- H. The owner or operator shall maintain a record of 30-day rolling average in lbs/MMBtu of NOx emissions.
- I. The owner or operator shall maintain a record of 3-hour rolling average in lbs/MMBtu of SO2 emissions.
- J. The owner or operator shall maintain a record of 12-month rolling totals in tons of NOx, SO2, and CO emissions.
- K. The owner or operator shall submit quarterly reports on opacity, SO2, NOx, CO2, and airflow to the Administrator and IDNR. For those items only required to be submitted to the Administrator regarding the Acid Rain requirements, do not send a duplicate copy of these items to IDNR. These reports shall conform to the requirements of 40 CFR Part 75.

Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 306

Stack Opening (inches, dia.): 141

Exhaust Temperature (°F): 400

Exhaust Flowrate (scfm): 460,100

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Stack Testing:

Pollutant - CO

Stack Test to be Completed by - March 22, 2014

Test Method - 40 CFR 60, Appendix A, Method 10

Authority for Requirement: 567 IAC 22.108(3)

Pollutant – Particulate Matter (PM)

1st Stack Test to be Completed by – March 22, 2013

2nd Stack Test to be Completed between – September 22, 2014 and September 22, 2015

Test Method - Iowa Compliance Sampling Manual Method 5

Authority for Requirement - 567 IAC 22.108(3)

Pollutant – Particulate Matter (PM₁₀)

1st Stack Test to be Completed by – March 22, 2013

2nd Stack Test to be Completed between – September 22, 2014 and September 22, 2015

Test Method - 40 CFR 51, Appendix M, 201A with 202 or approved alternative

Authority for Requirement - 567 IAC 22.108(3)

The owner of this equipment or the owner's authorized agent shall provide written notice to the Director, not less than 30 days before a required stack test. Results of the test shall be submitted in writing to the Director in the form of a comprehensive report within 6 weeks of the completion of the testing. 567 IAC 25.1(7)

Continuous emission monitoring is required for Opacity, Sulfur Dioxide, Nitrogen Oxides, Carbon Dioxide, and airflow. The monitoring shall be maintained in accordance with the most recent version of the Title V Operating Permit and 40 CFR Part 75.

Authority for Requirement: Iowa DNR Construction Permit 93-A-390-S10

Continuous Emissions Monitoring:

Pollutant - Opacity

Operational Specifications - 40 CFR Part 75

Initial System Calibration/Quality Assurance - 10/20/94

Ongoing System Calibration/Quality Assurance - 40 CFR Part 75

Reporting & Record keeping - 40 CFR Part 75

Authority for Requirement - 567 IAC 25.1(1) and 567 IAC 25.2

Iowa DNR Construction Permit 93-A-390-S10

Pollutant - Sulfur Dioxide (SO₂)

Operational Specifications - 40 CFR Part 75

Initial System Calibration/Quality Assurance - 10/20/94

Ongoing System Calibration/Quality Assurance - 40 CFR Part 75

Reporting & Record keeping - 40 CFR Part 75

Authority for Requirement - 567 IAC 25.2

Iowa DNR Construction Permit 93-A-390-S10

Pollutant - Nitrogen Oxides (NO_x)

Operational Specifications - 40 CFR Part 75

Initial System Calibration/Quality Assurance 10/20/94

Ongoing System Calibration/Quality Assurance - 40 CFR Part 75

Reporting & Record keeping - 40 CFR Part 75

Authority for Requirement - 567 IAC 25.2

Iowa DNR Construction Permit 93-A-390-S10

Other Parameters

Pollutant - Other - Carbon Dioxide (CO₂)

Operational Specifications - 40 CFR Part 75

Initial System Calibration/Quality Assurance - 10/20/94

Ongoing System Calibration/Quality Assurance - 40 CFR Part 75

Reporting & Record keeping - 40 CFR Part 75

Authority for Requirement - 567 IAC 25.2

Iowa DNR Construction Permit 93-A-390-S10

Pollutant - Other - Flow

Operational Specifications - 40 CFR Part 75

Initial System Calibration/Quality Assurance - 10/20/94

Ongoing System Calibration/Quality Assurance - 40 CFR Part 75

Reporting & Record keeping - 40 CFR Part 75

Authority for Requirement - 567 IAC 25.2

Iowa DNR Construction Permit 93-A-390-S10

The owner of this equipment or the owner's authorized agent shall provide written notice to the Director, not less than 30 days before a required stack test or performance evaluation of a continuous emission monitor. Results of the test shall be submitted in writing to the Director in the form of a comprehensive report within 6 weeks of the completion of the testing. 567 IAC 25.1(7)

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Relevant requirements of CAM plan for this equipment: PM and PM₁₀

CAM Plan for Main Plant Boiler (EU 17) is listed in Appendix A (p. 96) to this permit.

Authority for Requirement: 567 IAC 22.108(3)

40 CFR 64

Emission Point ID Number: EP 18

Associated Equipment

Associated Emission Unit ID Number: EU 18
Emissions Control Equipment Description: Water Delivery

Emission Unit vented through this Emission Point: EU 18
Emission Unit Description: Ash Hydroveyor
Raw Material/Fuel: Fly Ash
Rated Capacity: 10.3 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 40%
Authority for Requirement: 567 IAC 23.3(2)"d"

Pollutant: Particulate Matter
Emission Limits: 0.1 gr/dscf
Authority for Requirement: 567 IAC 23.3(2)"a"

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 18-1

Associated Equipment

Associated Emission Unit ID Number: EU 18-1
Emissions Control Equipment Description: Water Delivery

Emission Unit vented through this Emission Point: EU 18-1
Emission Unit Description: Ash Hydroveyor
Raw Material/Fuel: Fly Ash
Rated Capacity: 10.3 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 40%
Authority for Requirement: 567 IAC 23.3(2)"d"

Pollutant: Particulate Matter
Emission Limits: 0.1 gr/dscf
Authority for Requirement: 567 IAC 23.3(2)"a"

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 19

Associated Equipment

Associated Emission Unit ID Number: EU 19
Emissions Control Equipment ID Number: CE 19
Emissions Control Equipment Description: Baghouse

Emission Unit vented through this Emission Point: EU 19
Emission Unit Description: Dry Fly Ash Primary Vacuum Producer
Raw Material/Fuel: Fly Ash
Rated Capacity: 10.0 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 20%
Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2
567 IAC 22.3(3)

Pollutant: PM₁₀
Emission Limits: 0.27 lb/hr
Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2

Pollutant: Particulate Matter
Emission Limits: 0.1 gr/dscf
Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2
567 IAC 23.3(2)"a"

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Work Practice Standards:

Operation of the Fly Ash Backup Vacuum Producer and related baghouse shall conform to the following:

- A. The Fly Ash Backup Vacuum Producer (EP 19-1) is permitted to operate only when the Fly Ash Handling Primary Vacuum Producer (EP 19) is not operating.

- B. The owner or operator of the Fly Ash Primary Vacuum Producer baghouse is required to install replacement bags which have a collection efficiency that is comparable to or higher than the efficiency of the bags installed during initial emissions compliance testing of the Fly Ash Primary Vacuum Producer (EP 19).

Reporting and Record Keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Date on which bags are replaced in Fly Ash Primary Vacuum Producer baghouse.
- B. Bag manufacturer's specifications for bags installed in Fly Ash Primary Vacuum Producer baghouse.
- C. Log of maintenance and repairs performed on the Fly Ash Primary Vacuum Producer baghouse.

Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 23

Stack Opening (inches, dia.): 10.0

Exhaust Temperature (°F): 150

Exhaust Flowrate (acfm): 2,312

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)"

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60 days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

- The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (> 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.
- Check and document the baghouse pressure drop. If the pressure drop falls out of the normal operating range, specified by the manufacturer, corrective action will be taken within eight hours to return the pressure drop to normal.
- Check the broken bag indicator. If the indicator shows a broken bag, corrective action will be taken within eight hours to repair or replace the bag.

Maintain a written record of the observation and any action resulting from the inspection.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannual

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: Iowa DNR Construction Permit 95-A-597-S2
567 IAC 22.108(3)

Emission Point ID Number: 19-1

Associated Equipment

Associated Emission Unit ID Number: EU 19-1
Emissions Control Equipment ID Number: CE 19
Emissions Control Equipment Description: Baghouse

Emission Unit vented through this Emission Point: EU 19-1
Emission Unit Description: Dry Fly Ash Backup Vacuum Producer
Raw Material/Fuel: Fly Ash
Rated Capacity: 10.0 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: 20%

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1
567 IAC 22.3(3)

Pollutant: PM₁₀

Emission Limits: 0.27 lb/hr

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1

Pollutant: Particulate Matter

Emission Limits: 0.1 gr/dscf

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1
567 IAC 23.3(2)"a"

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Work practice standards:

Operation of the Fly Ash Backup Vacuum Producer and related baghouse shall conform to the following:

- A. The Fly Ash Backup Vacuum Producer (EP 19-1) is permitted to operate only when the Fly Ash Handling Primary Vacuum Producer (EP 19) is not operating.

- B. The owner or operator of the Fly Ash Backup Vacuum Producer baghouse is required to install replacement bags which have a collection efficiency that is comparable to or higher than the efficiency of the bags installed during initial emissions compliance testing of the Fly Ash Primary Vacuum Producer (EP 19).

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Date on which bags are replaced in Fly Ash Primary Vacuum Producer baghouse.
- B. Bag manufacturer's specifications for bags installed in Fly Ash Primary Vacuum Producer baghouse.
- C. Log of maintenance and repairs performed on the Fly Ash Primary Vacuum Producer baghouse.

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 23

Stack Opening (inches, dia.): 10.0

Exhaust Temperature (°F): 150

Exhaust Flowrate (acfm): 2,312

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60 days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

- The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (> 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.
- Check and document the baghouse pressure drop. If the pressure drop falls out of the normal operating range, specified by the manufacturer, corrective action will be taken within eight hours to return the pressure drop to normal.
- Check the broken bag indicator. If the indicator shows a broken bag, corrective action will be taken within eight hours to repair or replace the bag.

Maintain a written record of the observation and any action resulting from the inspection.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannual

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: Iowa DNR Construction Permit 97-A-127-S1
567 IAC 22.108(3)

Emission Point ID Number: EP 20

Associated Equipment

Associated Emission Unit ID Number: EU 20
Emissions Control Equipment ID Number: CE 20
Emissions Control Equipment Description: Baghouse

Emission Unit vented through this Emission Point: EU 20
Emission Unit Description: Fly Ash Storage Silo
Raw Material/Fuel: Fly Ash
Rated Capacity: 10.0 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 20%
Authority for Requirement: Iowa DNR Construction Permit 97-A-126
567 IAC 22.3(3)

Pollutant: PM₁₀
Emission Limits: 0.85 lb/hr
Authority for Requirement: Iowa DNR Construction Permit 97-A-126

Pollutant: Particulate Matter
Emission Limits: 0.1 gr/dscf
Authority for Requirement: Iowa DNR Construction Permit 97-A-126
567 IAC 23.3(2)"a"

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Control equipment parameters:

Operation of the Fly Ash Storage Silo and related baghouse shall conform to the following:

The owner or operator of the Fly Ash Storage Silo baghouse is required to install replacement bags which have a collection efficiency that is comparable to or higher than the efficiency of the bags installed during initial emissions compliance testing.

Reporting and Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

- A. Date on which bags are replaced in Fly Ash Storage Silo baghouse.
- B. Bag manufacturer's specifications for bags installed in Fly Ash Storage Silo baghouse.
- C. Log of maintenance and repairs performed on the Fly Ash Storage Silo baghouse.

Authority for Requirement: Iowa DNR Construction Permit 97-A-126

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 127

Stack Opening (inches, dia.): 10.0

Exhaust Temperature (°F): 70

Exhaust Flowrate (acfm): 1,400

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 97-A-126

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60 days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

- The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (> 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.
- Check and document the baghouse pressure drop. If the pressure drop falls out of the normal operating range, specified by the manufacturer, corrective action will be taken within eight hours to return the pressure drop to normal.

Maintain a written record of the observation and any action resulting from the inspection.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannually

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: Iowa DNR Construction Permit 97-A-126
567 IAC 22.108(3)

Emission Point ID Number: EP 20A

Associated Equipment

Associated Emission Unit ID Number: EU 20A
Emissions Control Equipment ID Number: CE 20a
Emissions Control Equipment Description: Telescoping Chute

Emission Unit vented through this Emission Point: EU 20a
Emission Unit Description: Fly Ash Unloading
Raw Material/Fuel: Fly Ash
Rated Capacity: 100.0 tons/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 20B

Associated Equipment

Associated Emission Unit ID Number: EU 20B
Emissions Control Equipment ID Number: CE 20b
Emissions Control Equipment Description: Water Spray

Emission Unit vented through this Emission Point: EU 20B
Emission Unit Description: Fly Ash Loadout – C-Stone Production
Raw Material/Fuel: Fly Ash
Rated Capacity: 75 tons/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 22

Associated Equipment

Associated Emission Unit ID Number: EU 22

Emission Unit vented through this Emission Point: EU 22
Emission Unit Description: Fuel Oil Tank (10,000 gallons)
Raw Material/Fuel: Fuel Oil
Rated Capacity: 417 gal/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

No applicable limits at this time.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 23

Associated Equipment

Associated Emission Unit ID Number: EU 23

Emission Unit vented through this Emission Point: EU 23
Emission Unit Description: Fuel Oil Tank (10,000 gallons)
Raw Material/Fuel: Fuel Oil
Rated Capacity: 413 gal/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

No applicable limits at this time.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 25**Associated Equipment**

Associated Emission Unit ID Number: EU 25
Emissions Control Equipment ID Number: CE 25
Emissions Control Equipment Description: Fabric Filter Baghouse

Emission Unit vented through this Emission Point: EU 25
Emission Unit Description: Coal Galley
Raw Material/Fuel: Coal
Rated Capacity: 500 tons/hr

Applicable Requirements**Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)**

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: Iowa DNR Construction Permit 93-A-386-S2
567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Pollutant: PM₁₀

Emission Limits: 1.63 lb/hr

Authority for Requirement: Iowa DNR Construction Permit 93-A-386-S2

Pollutant: Particulate Matter

Emission Limits: 0.1 gr/dscf

Authority for Requirement: 567 IAC 23.3(2)"a" (Iowa DNR Construction Permit 93-A-386-S2)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Process Throughput:

A. The maximum operating capacity for this equipment shall not exceed 375 tons/hr. This shall be based on a 24-hour average.

Reporting & Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

A. Record and calculate the coal flow rate (tons/hr) average over a 24-hour period.

Authority for Requirement: Iowa DNR Construction Permit 93-A-386-S2

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 152

Stack Opening (inches, dia.): 22

Exhaust Temperature (°F): Ambient

Exhaust Flowrate (scfm): 9,500

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 93-A-386-S2

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Stack Testing:

Pollutant - Particulate Matter

Stack Test to be Completed by: March 22, 2014

Test Method: Iowa Compliance Sampling Manual Method 5

Authority for Requirement - 567 IAC 22.108(3)

Pollutant - PM₁₀

Stack Test to be Completed by: March 22, 2014

Test Method - 40 CFR 51, Appendix M, 201A with 202 or Approved Alternative

Authority for Requirement - 567 IAC 22.108(3)

The owner of this equipment or the owner’s authorized agent shall provide written notice to the Director, not less than 30 days before a required stack test or performance evaluation of a continuous emission monitor. Results of the test shall be submitted in writing to the Director in the form of a comprehensive report within 6 weeks of the completion of the testing. 567 IAC 25.1(7)

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60

days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

- The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.
- Check and document the baghouse pressure drop. If the pressure drop falls out of the normal operating range, specified by the manufacturer, corrective action will be taken within eight hours to return the pressure drop to normal.

Maintain a written record of the observation and any action resulting from the inspection.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannually

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Emission Point ID Number: EP 25A (Fugitive)

Associated Equipment

Associated Emission Unit ID Number: EU 25

Emission Unit vented through this Emission Point: EU 25

Emission Unit Description: Coal Galley

Raw Material/Fuel: Coal

Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: 567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are

being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Opacity Monitoring

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 26

Associated Equipment

Associated Emission Unit ID Number: EU 26

Emission Unit vented through this Emission Point: EU 26

Emission Unit Description: Coal Storage Pile

Raw Material/Fuel: Coal

Rated Capacity/Size: 4.63 Acres

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to create a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for requirement: 567 IAC 23.3(2)"c".

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 27

Associated Equipment

Associated Emission Unit ID Number: EU 27
Emissions Control Equipment ID Number: CE 27
Emissions Control Equipment Description: Fabric Filter Baghouse

Emission Unit vented through this Emission Point: EU 27
Emission Unit Description: Coal Dumper House (Track Hoppers)
Raw Material/Fuel: Coal
Rated Capacity: 1000 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: Iowa DNR Construction Permit 93-A-389-S1
567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Pollutant: PM₁₀

Emission Limits: 0.02 gr/dscf, 1.97 lb/hr, and 8.62 tons/yr

Authority for Requirement: Iowa DNR Construction Permit 93-A-389-S1

Pollutant: Particulate Matter

Emission Limits: 0.1 gr/dscf

Authority for Requirement: 567 IAC 23.3(2)"a"

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing

emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 13

Stack Opening (inches, dia.): 23

Exhaust Temperature (°F): Ambient

Exhaust Flowrate (scfm): 11,500

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 93-A-389-S1

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60 days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannually

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 28 (Fugitive)

Associated Equipment

Associated Emission Unit ID Number: EU 28

Emission Unit vented through this Emission Point: EU 28

Emission Unit Description: Coal Reclaim Tripper

Raw Material/Fuel: Coal

Rated Capacity/Size: 500 ton/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to create a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for requirement: 567 IAC 23.3(2)"c".

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 29

Associated Equipment

Associated Emission Unit ID Number: EU 29

Emission Unit vented through this Emission Point: EU 29

Emission Unit Description: Barge Hopper

Raw Material/Fuel: Coal

Rated Capacity/Size: 1,000 ton/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to create a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for requirement: 567 IAC 23.3(2)"c".

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 30 (Fugitive)

Associated Equipment

Associated Emission Unit ID Numbers: EU 30 and EU 38

Emission Unit vented through this Emission Point: EU 30

Emission Unit Description: Crusher

Raw Material/Fuel: Coal

Rated Capacity: 1000 tons/hr

Emission Unit vented through this Emission Point: EU 38

Emission Unit Description: Crusher House Conveyor

Raw Material/Fuel: Coal

Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: 567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Opacity Monitoring

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 31 (Fugitive)

Associated Equipment

Associated Emission Unit ID Numbers: EU 31 and EU 37

Emission Unit vented through this Emission Point: EU 31

Emission Unit Description: Transfer Equipment

Raw Material/Fuel: Coal

Rated Capacity: 500 tons/hr

Emission Unit vented through this Emission Point: EU 37

Emission Unit Description: Transfer House Conveyor

Raw Material/Fuel: Coal

Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb/hr, gr/dscf, lb/MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance.

All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: 567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Opacity Monitoring

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 40

Associated Equipment

Associated Emission Unit ID Number: EU 40
Emissions Control Equipment ID Number: CE 31
Emissions Control Equipment Description: Fabric Filter Baghouse

Emission Unit vented through this Emission Point: EU 40
Emission Unit Description: Reclaim Hopper
Raw Material/Fuel: Coal
Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: Less Than 20%
Authority for Requirement: Iowa DNR Construction Permit 93-A-388-S3
567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Pollutant: PM₁₀
Emission Limits: 3.14 lb/hr
Authority for Requirement: Iowa DNR Construction Permit 93-A-388-S3

Pollutant: Particulate Matter
Emission Limits: 0.1 gr/dscf
Authority for Requirement: 567 IAC 23.3(2)"a" (Iowa DNR Construction Permit 93-A-388-S3)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below

Process Throughput:

A. The maximum operating capacity for this equipment shall not exceed 375 tons/hr. This shall be based on a 24-hour average.

Reporting & Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

A. Record and calculate the coal flow rate (tons/hr) average over a 24-hour period.

Authority for Requirement: Iowa DNR Construction Permit 93-A-388-S3

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 33

Stack Opening (inches, dia.): 32

Exhaust Temperature (°F): Ambient

Exhaust Flowrate (scfm): 18,300

Discharge Style: Vertical Unobstructed

Authority for Requirement: Iowa DNR Construction Permit 93-A-388-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Stack Testing:

Pollutant - Particulate Matter (PM)
Stack Test to be Completed by: March 22, 2014
Test Method: Iowa Compliance Sampling Manual Method 5
Authority for Requirement - 567 IAC 22.108(3)

Pollutant - PM₁₀
Stack Test to be Completed by: March 22, 2014
Test Method - 40 CFR 51, Appendix M, 201A with 202 or Approved Alternative
Authority for Requirement - 567 IAC 22.108(3)

The owner of this equipment or the owner’s authorized agent shall provide written notice to the Director, not less than 30 days before a required stack test or performance evaluation of a continuous emission monitor. Results of the test shall be submitted in writing to the Director in the form of a comprehensive report within 6 weeks of the completion of the testing. 567 IAC 25.1(7)

Agency Approved Operation & Maintenance Plan Required? Yes No
Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60

days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannually

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 40A (Fugitive)

Associated Equipment

Associated Emission Unit ID Number: EU 40

Emission Unit vented through this Emission Point: EU 40

Emission Unit Description: Reclaim Hopper

Raw Material/Fuel: Coal

Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Fugitive Dust

Emission Limit: No person shall allow, cause or permit any materials to be handled, transported or stored; or a building, its appurtenances or a construction haul road to be used, constructed, altered, repaired or demolished, without taking reasonable precautions to prevent a nuisance. All persons shall take reasonable precautions to prevent the discharge of visible emissions of fugitive dusts beyond the lot line of the property on which the emissions originate.

Authority for Requirement: 567 IAC 23.3(2)"c"

Pollutant: Opacity

Emission Limits: Less Than 20%

Authority for Requirement: 567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is

not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Opacity Monitoring

The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: 44

Associated Equipment

Emission Unit vented through this Emission Point: EU 44
Emission Unit Description: Natural Gas Heater (Indirect Heating)
Raw Material/Fuel: Natural Gas
Rated Capacity: 2 MMBtu/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: 40%
Authority for Requirement: 567 IAC 23.3(2)"d"

Pollutant: Particulate Matter
Emission Limits: 0.8 lb/MMBtu
Authority for Requirement: 567 IAC 23.3(2)"b"

Pollutant: Sulfur Dioxide (SO₂)
Emission Limits: 500 ppmv
Authority for Requirement: 567 IAC 23.3(3)"e"

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Agency Approved Operation & Maintenance Plan Required? Yes No

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Emission Point ID Number: EP 100

Associated Equipment

Associated Emission Unit ID Numbers: EU 30, EU 38, EU 31, and EU 37
Emissions Control Equipment ID Number: CE 30
Emissions Control Equipment Description: Fabric Filter Baghouse

Emission Unit vented through this Emission Point: EU 30
Emission Unit Description: Crusher
Raw Material/Fuel: Coal
Rated Capacity: 1000 tons/hr

Emission Unit vented through this Emission Point: EU 38
Emission Unit Description: Crusher House Conveyor
Raw Material/Fuel: Coal
Rated Capacity: 500 tons/hr

Emission Unit vented through this Emission Point: EU 31
Emission Unit Description: Transfer Equipment
Raw Material/Fuel: Coal
Rated Capacity: 500 tons/hr

Emission Unit vented through this Emission Point: EU 37
Emission Unit Description: Transfer House Conveyor
Raw Material/Fuel: Coal
Rated Capacity: 500 tons/hr

Applicable Requirements

Emission Limits (lb./hr, gr./dscf, lb./MMBtu, % opacity, etc.)

The emissions from this emission point shall not exceed the levels specified below.

Pollutant: Opacity
Emission Limits: Less Than 20%
Authority for Requirement: Iowa DNR Construction Permit 93-A-387-S3
567 IAC 23.1(2)"v"
40 CFR 60.254(a) (Subpart Y)

Pollutant: PM₁₀
Emission Limits: 3.05 lb/hr
Authority for Requirement: Iowa DNR Construction Permit 93-A-387-S3

Pollutant: Particulate Matter

Emission Limits: 0.1 gr/dscf

Authority for Requirement: 567 IAC 23.3(2)"a" (Iowa DNR Construction Permit 93-A-387-S3)

Operational Limits & Requirements

The owner/operator of this equipment shall comply with the operational limits and requirements listed below.

Process Throughput:

A. The maximum operating capacity for each of the equipment EU 30, 38, 31 and 37 shall not exceed 375 tons/hr. This shall be based on a 24-hour average.

Reporting & Record keeping:

All records as required by this permit shall be kept on-site for a minimum of five (5) years and shall be available for inspection by the DNR. Records shall be legible and maintained in an orderly manner.

A. Record and calculate the coal flow rate (tons/hr) average for each of the equipment EU 30, 38, 31 and 37 over a 24-hour period.

Authority for Requirements: Iowa DNR Construction Permit 93-A-387-S3

NSPS Requirements:

The opacity standard shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard. 40 CFR 60.11(c)

At all times, including periods of startup, shutdown, and malfunction, the permittee shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source. 40 CFR 60.11(d)

The permittee shall not build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard that is based on the concentration of a pollutant in the gases discharged to the atmosphere. 40 CFR 60.12

Authority for Requirement: 567 IAC 23.1(2)

Emission Point Characteristics

The emission point shall conform to the specifications listed below.

Stack Height (feet, from the ground): 33
Stack Opening (inches, dia.): 32
Exhaust Temperature (°F): Ambient
Exhaust Flowrate (scfm): 17,750
Discharge Style: Vertical Unobstructed
Authority for Requirement: Iowa DNR Construction Permit 93-A-387-S3

The temperature and flow rate are intended to be representative and characteristic of the design of the permitted emission point. The Department recognizes that the temperature and flow rate may vary with changes in the process and ambient conditions. If it is determined that any of the emission point design characteristics are different than the values stated above, the owner/operator must notify the Department and obtain a permit amendment, if required.

Monitoring Requirements

The owner/operator of this equipment shall comply with the monitoring requirements listed below.

Stack Testing:

Pollutant - Particulate Matter (PM)
Stack Test to be Completed by: March 22, 2014
Test Method: Iowa Compliance Sampling Manual Method 5
Authority for Requirement - 567 IAC 22.108(3)

Pollutant - PM₁₀
Stack Test to be Completed by: March 22, 2014
Test Method - 40 CFR 51, Appendix M, 201A with 202 or Approved Alternative
Authority for Requirement - 567 IAC 22.108(3)

The owner of this equipment or the owner’s authorized agent shall provide written notice to the Director, not less than 30 days before a required stack test or performance evaluation of a continuous emission monitor. Results of the test shall be submitted in writing to the Director in the form of a comprehensive report within 6 weeks of the completion of the testing. 567 IAC 25.1(7)

Agency Approved Operation & Maintenance Plan Required? Yes No

Relevant requirements of O & M plan for this equipment: PM/PM₁₀

Facility Maintained Operation & Maintenance Plan Required? Yes No

Compliance Assurance Monitoring (CAM) Plan Required? Yes No

Authority for Requirement: 567 IAC 22.108(3)

Baghouse Agency Operation & Maintenance Plan

Monitoring Guidelines

The facility makes a commitment to take timely corrective action during periods of excursion where the indicators are out of range. A corrective action may include an investigation of the reason for the excursion, evaluation of the situation and necessary follow-up action to return operation within the indicator range. An excursion is determined by the averaged discrete data point over a period of time. An excursion does not necessarily indicate a violation of an applicable requirement. If the corrective action measures fail to return the indicators to the appropriate range, the facility will report the exceedance to the department and conduct source testing within 90 days of the exceedance to demonstrate compliance with applicable requirements. If the test demonstrates compliance with emission limits then new indicator ranges must be set for monitoring and the new ranges must be incorporated in the operating permit. If the test demonstrates noncompliance with emission limits, then the facility, within 60 days, proposes a schedule to implement corrective action to bring the source into compliance and demonstrate compliance.

General

Periodic Monitoring is not required during periods of time greater than one day in which the source does not operate.

Weekly

- The facility shall check for visible emissions weekly during a period when the emission unit on this emission point is at or near full capacity and record the observation. Maintain a written record of the observation and any action resulting from the observation for a minimum of five years. Visible emissions shall be observed to ensure that no visible emissions occur during the material handling operation of the unit. If visible emissions are observed corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If corrective action does not return the observation to no visible emissions, then a Method 9 observation will be required. If an opacity (equal to or greater than 20%) is observed, this would be a violation and corrective action will be taken as soon as possible, but no later than eight hours from the observation of visible emissions. If weather conditions prevent the observer from conducting a visible emission observation or an opacity observation, the observer shall note such conditions on the data observation sheet. At least three attempts shall be made to retake visible observations or Method 9 opacity observations at approximately 2-hour intervals throughout the day. If all observation attempts for a week have been unsuccessful due to weather, an observation shall be made the next operating day where weather permits.

Monthly

- Check the cleaning sequence of the baghouse
- Pulse jet baghouse - check the air delivery system
- Check hopper functions and performance

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Quarterly

- Thoroughly inspect bags for leaks and wear. (Look for obvious holes or tears in the bags.)

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Bag replacement should be documented by identifying the date, time and location of the bag in relationship to the other bags. The location should be identified on an overhead drawing of the bag layout in the baghouse. Maintain a written record of the inspection and any action resulting from the inspection.

Semiannually

- Inspect every six months all components that are not subject to wear or plugging, including structural components, housing, ducts and hoods.

If leaks or abnormal conditions are detected the appropriate measures for remediation will be implemented within eight hours. Maintain a written record of the inspection and any action resulting from the inspection.

Record Keeping and Reporting

Maintenance and inspection records will be kept for five years and available upon request.

Quality Control

The filter equipment will be operated and maintained according to the manufacturer recommendations.

Authority for Requirement: 567 IAC 22.108(3)

IV. General Conditions

This permit is issued under the authority of the Iowa Code subsection 455B.133(8) and in accordance with 567 Iowa Administrative Code chapter 22.

G1. Duty to Comply

1. The permittee must comply with all conditions of the Title V permit. Any permit noncompliance constitutes a violation of the Act and is grounds for enforcement action; for a permit termination, revocation and reissuance, or modification; or for denial of a permit renewal application. *567 IAC 22.108(9)"a"*
2. Any compliance schedule shall be supplemental to, and shall not sanction noncompliance with, the applicable requirements on which it is based. *567 IAC 22.105 (2)"h"(3)*
3. Where an applicable requirement of the Act is more stringent than an applicable requirement of regulations promulgated under Title IV of the Act, both provisions shall be enforceable by the administrator and are incorporated into this permit. *567 IAC 22.108 (1)"b"*
4. Unless specified as either "state enforceable only" or "local program enforceable only", all terms and conditions in the permit, including provisions to limit a source's potential to emit, are enforceable by the administrator and citizens under the Act. *567 IAC 22.108 (14)*
5. It shall not be a defense for a permittee, in an enforcement action, that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit. *567 IAC 22.108 (9)"b"*

G2. Permit Expiration

1. Except as provided in rule 567—22.104(455B), permit expiration terminates a source's right to operate unless a timely and complete application for renewal has been submitted in accordance with rule 567—22.105(455B). *567 IAC 22.116(2)*
2. To be considered timely, the owner, operator, or designated representative (where applicable) of each source required to obtain a Title V permit shall submit on forms or electronic format specified by the Department to the Air Quality Bureau, Iowa Department of Natural Resources, Air Quality Bureau, 7900 Hickman Rd, Suite #1, Windsor Heights, Iowa 50324, two copies (three if your facility is located in Linn or Polk county) of a complete permit application, at least 6 months but not more than 18 months prior to the date of permit expiration. An additional copy must also be sent to EPA Region VII, Attention: Chief of Air Permits, 901 N. 5th St., Kansas City, KS 66101. Additional copies to local programs or EPA are not required for application materials submitted through the electronic format specified by the Department. The application must include all emission points, emission units, air pollution control equipment, and monitoring devices at the facility. All emissions generating activities, including fugitive emissions, must be included. The definition of a complete application is as indicated in 567 IAC 22.105(2). *567 IAC 22.105*

G3. Certification Requirement for Title V Related Documents

Any application, report, compliance certification or other document submitted pursuant to this permit shall contain certification by a responsible official of truth, accuracy, and completeness. All certifications shall state that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. *567 IAC 22.107 (4)*

G4. Annual Compliance Certification

By March 31 of each year, the permittee shall submit compliance certifications for the previous calendar year. The certifications shall include descriptions of means to monitor the compliance status of all emissions sources including emissions limitations, standards, and work practices in

accordance with applicable requirements. The certification for a source shall include the identification of each term or condition of the permit that is the basis of the certification; the compliance status; whether compliance was continuous or intermittent; the method(s) used for determining the compliance status of the source, currently and over the reporting period consistent with all applicable department rules. For sources determined not to be in compliance at the time of compliance certification, a compliance schedule shall be submitted which provides for periodic progress reports, dates for achieving activities, milestones, and an explanation of why any dates were missed and preventive or corrective measures. The compliance certification shall be submitted to the administrator, director, and the appropriate DNR Field office. *567 IAC 22.108 (15)"e"*

G5. Semi-Annual Monitoring Report

By March 31 and September 30 of each year, the permittee shall submit a report of any monitoring required under this permit for the 6 month periods of July 1 to December 31 and January 1 to June 30, respectively. All instances of deviations from permit requirements must be clearly identified in these reports, and the report must be signed by a responsible official, consistent with 567 IAC 22.107(4). The semi-annual monitoring report shall be submitted to the director and the appropriate DNR Field office. *567 IAC 22.108 (5)*

G6. Annual Fee

1. The permittee is required under subrule 567 IAC 22.106 to pay an annual fee based on the total tons of actual emissions of each regulated air pollutant. Beginning July 1, 1996, Title V operating permit fees will be paid on July 1 of each year. The fee shall be based on emissions for the previous calendar year.
2. The fee amount shall be calculated based on the first 4,000 tons of each regulated air pollutant emitted each year. The fee to be charged per ton of pollutant will be available from the department by June 1 of each year. The Responsible Official will be advised of any change in the annual fee per ton of pollutant.
3. The following forms shall be submitted annually by March 31 documenting actual emissions for the previous calendar year.
 - a. Form 1.0 "Facility Identification";
 - b. Form 4.0 "Emissions unit-actual operations and emissions" for each emission unit;
 - c. Form 5.0 "Title V annual emissions summary/fee"; and
 - d. Part 3 "Application certification."
4. The fee shall be submitted annually by July 1. The fee shall be submitted with the following forms:
 - a. Form 1.0 "Facility Identification";
 - b. Form 5.0 "Title V annual emissions summary/fee";
 - c. Part 3 "Application certification."
5. If there are any changes to the emission calculation form, the department shall make revised forms available to the public by January 1. If revised forms are not available by January 1, forms from the previous year may be used and the year of emissions documented changed. The department shall calculate the total statewide Title V emissions for the prior calendar year and make this information available to the public no later than April 30 of each year.
6. Phase I acid rain affected units under section 404 of the Act shall not be required to pay a fee for emissions which occur during the years 1993 through 1999 inclusive.
7. The fee for a portable emissions unit or stationary source which operates both in Iowa and out of state shall be calculated only for emissions from the source while operating in Iowa.

8. Failure to pay the appropriate Title V fee represents cause for revocation of the Title V permit as indicated in 567 IAC 22.115(1)"d".

G7. Inspection of Premises, Records, Equipment, Methods and Discharges

Upon presentation of proper credentials and any other documents as may be required by law, the permittee shall allow the director or the director's authorized representative to:

1. Enter upon the permittee's premises where a Title V source is located or emissions-related activity is conducted, or where records must be kept under the conditions of the permit;
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permit;
3. Inspect, at reasonable times, any facilities, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under the permit; and
4. Sample or monitor, at reasonable times, substances or parameters for the purpose of ensuring compliance with the permit or other applicable requirements. *567 IAC 22.108 (15)"b"*

G8. Duty to Provide Information

The permittee shall furnish to the director, within a reasonable time, any information that the director may request in writing to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit or to determine compliance with the permit. Upon request, the permittee also shall furnish to the director copies of records required to be kept by the permit, or for information claimed to be confidential, the permittee shall furnish such records directly to the administrator of EPA along with a claim of confidentiality. *567 IAC 22.108 (9)"e"*

G9. General Maintenance and Repair Duties

The owner or operator of any air emission source or control equipment shall:

1. Maintain and operate the equipment or control equipment at all times in a manner consistent with good practice for minimizing emissions.
2. Remedy any cause of excess emissions in an expeditious manner.
3. Minimize the amount and duration of any excess emission to the maximum extent possible during periods of such emissions. These measures may include but not be limited to the use of clean fuels, production cutbacks, or the use of alternate process units or, in the case of utilities, purchase of electrical power until repairs are completed.
4. Schedule, at a minimum, routine maintenance of equipment or control equipment during periods of process shutdowns to the maximum extent possible. *567 IAC 24.2(1)*

G10. Recordkeeping Requirements for Compliance Monitoring

1. In addition to any source specific recordkeeping requirements contained in this permit, the permittee shall maintain the following compliance monitoring records, where applicable:

- a. The date, place and time of sampling or measurements
- b. The date the analyses were performed.
- c. The company or entity that performed the analyses.
- d. The analytical techniques or methods used.
- e. The results of such analyses; and
- f. The operating conditions as existing at the time of sampling or measurement.
- g. The records of quality assurance for continuous compliance monitoring systems (including but not limited to quality control activities, audits and calibration drifts.)

2. The permittee shall retain records of all required compliance monitoring data and support information for a period of at least 5 years from the date of compliance monitoring sample, measurement report or application. Support information includes all calibration and maintenance

records and all original strip chart recordings for continuous compliance monitoring, and copies of all reports required by the permit.

3. For any source which in its application identified reasonably anticipated alternative operating scenarios, the permittee shall:

- a. Comply with all terms and conditions of this permit specific to each alternative scenario.
- b. Maintain a log at the permitted facility of the scenario under which it is operating.
- c. Consider the permit shield, if provided in this permit, to extend to all terms and conditions under each operating scenario. *567 IAC 22.108(4), 567 IAC 22.108(12)*

G11. Evidence used in establishing that a violation has or is occurring.

Notwithstanding any other provisions of these rules, any credible evidence may be used for the purpose of establishing whether a person has violated or is in violation of any provisions herein.

1. Information from the use of the following methods is presumptively credible evidence of whether a violation has occurred at a source:

- a. A monitoring method approved for the source and incorporated in an operating permit pursuant to 567 Chapter 22;
- b. Compliance test methods specified in 567 Chapter 25; or
- c. Testing or monitoring methods approved for the source in a construction permit issued pursuant to 567 Chapter 22.

2. The following testing, monitoring or information gathering methods are presumptively credible testing, monitoring, or information gathering methods:

- a. Any monitoring or testing methods provided in these rules; or
- b. Other testing, monitoring, or information gathering methods that produce information comparable to that produced by any method in subrule 21.5(1) or this subrule. *567 IAC 21.5(1)-567 IAC 21.5(2)*

G12. Prevention of Accidental Release: Risk Management Plan Notification and Compliance Certification

If the permittee is required to develop and register a risk management plan pursuant to section 112(r) of the Act, the permittee shall notify the department of this requirement. The plan shall be filed with all appropriate authorities by the deadline specified by EPA. A certification that this risk management plan is being properly implemented shall be included in the annual compliance certification of this permit. *567 IAC 22.108(6)*

G13. Hazardous Release

The permittee must report any situation involving the actual, imminent, or probable release of a hazardous substance into the atmosphere which, because of the quantity, strength and toxicity of the substance, creates an immediate or potential danger to the public health, safety or to the environment. A verbal report shall be made to the department at (515) 281-8694 and to the local police department or the office of the sheriff of the affected county as soon as possible but not later than six hours after the discovery or onset of the condition. This verbal report must be followed up with a written report as indicated in 567 IAC 131.2(2). *567 IAC Chapter 131-State Only*

G14. Excess Emissions and Excess Emissions Reporting Requirements

1. Excess Emissions. Excess emission during a period of startup, shutdown, or cleaning of control equipment is not a violation of the emission standard if the startup, shutdown or cleaning is accomplished expeditiously and in a manner consistent with good practice for minimizing emissions. Cleaning of control equipment which does not require the shutdown of the process

equipment shall be limited to one six-minute period per one-hour period. An incident of excess emission (other than an incident during startup, shutdown or cleaning of control equipment) is a violation. If the owner or operator of a source maintains that the incident of excess emission was due to a malfunction, the owner or operator must show that the conditions which caused the incident of excess emission were not preventable by reasonable maintenance and control measures. Determination of any subsequent enforcement action will be made following review of this report. If excess emissions are occurring, either the control equipment causing the excess emission shall be repaired in an expeditious manner or the process generating the emissions shall be shutdown within a reasonable period of time. An expeditious manner is the time necessary to determine the cause of the excess emissions and to correct it within a reasonable period of time. A reasonable period of time is eight hours plus the period of time required to shut down the process without damaging the process equipment or control equipment. In the case of an electric utility, a reasonable period of time is eight hours plus the period of time until comparable generating capacity is available to meet consumer demand with the affected unit out of service, unless, the director shall, upon investigation, reasonably determine that continued operation constitutes an unjustifiable environmental hazard and issue an order that such operation is not in the public interest and require a process shutdown to commence immediately.

2. Excess Emissions Reporting

a. Oral Reporting of Excess Emissions. An incident of excess emission (other than an incident of excess emission during a period of startup, shutdown, or cleaning) shall be reported to the appropriate field office of the department within eight hours of, or at the start of the first working day following the onset of the incident. The reporting exemption for an incident of excess emission during startup, shutdown or cleaning does not relieve the owner or operator of a source with continuous monitoring equipment of the obligation of submitting reports required in 567-subrule 25.1(6). An oral report of excess emission is not required for a source with operational continuous monitoring equipment (as specified in 567-subrule 25.1(1)) if the incident of excess emission continues for less than 30 minutes and does not exceed the applicable emission standard by more than 10 percent or the applicable visible emission standard by more than 10 percent opacity. The oral report may be made in person or by telephone and shall include as a minimum the following:

- i. The identity of the equipment or source operation from which the excess emission originated and the associated stack or emission point.
- ii. The estimated quantity of the excess emission.
- iii. The time and expected duration of the excess emission.
- iv. The cause of the excess emission.
- v. The steps being taken to remedy the excess emission.
- vi. The steps being taken to limit the excess emission in the interim period.

b. Written Reporting of Excess Emissions. A written report of an incident of excess emission shall be submitted as a follow-up to all required oral reports to the department within seven days of the onset of the upset condition, and shall include as a minimum the following:

- i. The identity of the equipment or source operation point from which the excess emission originated and the associated stack or emission point.
- ii. The estimated quantity of the excess emission.
- iii. The time and duration of the excess emission.

- iv. The cause of the excess emission.
- v. The steps that were taken to remedy and to prevent the recurrence of the incident of excess emission.
- vi. The steps that were taken to limit the excess emission.
- vii. If the owner claims that the excess emission was due to malfunction, documentation to support this claim. *567 IAC 24.1(1)-567 IAC 24.1(4)*

3. Emergency Defense for Excess Emissions. For the purposes of this permit, an “emergency” means any situation arising from sudden and reasonably unforeseeable events beyond the control of the source, including acts of God, which requires immediate corrective action to restore normal operation, and that causes the source to exceed a technology-based emission limitation under the permit due to unavoidable increases in emissions attributable to the emergency. An emergency shall not include non-compliance, to the extent caused by improperly designed equipment, lack of preventive maintenance, careless or improper operation or operator error. An emergency constitutes an affirmative defense to an action brought for non-compliance with technology based limitations if it can be demonstrated through properly signed contemporaneous operating logs or other relevant evidence that:

- a. An emergency occurred and that the permittee can identify the cause(s) of the emergency;
- b. The facility at the time was being properly operated;
- c. During the period of the emergency, the permittee took all reasonable steps to minimize levels of emissions that exceeded the emissions standards or other requirements of the permit; and
- d. The permittee submitted notice of the emergency to the director by certified mail within two working days of the time when the emissions limitations were exceeded due to the emergency. This notice must contain a description of the emergency, any steps taken to mitigate emissions, and corrective actions taken. *567 IAC 22.108(16)*

G15. Permit Deviation Reporting Requirements

A deviation is any failure to meet a term, condition or applicable requirement in the permit. Reporting requirements for deviations that result in a hazardous release or excess emissions have been indicated above (see G13 and G14). Unless more frequent deviation reporting is specified in the permit, any other deviation shall be documented in the semi-annual monitoring report and the annual compliance certification (see G4 and G5). *567 IAC 22.108(5)"b"*

G16. Notification Requirements for Sources That Become Subject to NSPS and NESHAP Regulations

During the term of this permit, the permittee must notify the department of any source that becomes subject to a standard or other requirement under 567-subrule 23.1(2) (standards of performance of new stationary sources) or section 111 of the Act; or 567-subrule 23.1(3) (emissions standards for hazardous air pollutants), 567-subrule 23.1(4) (emission standards for hazardous air pollutants for source categories) or section 112 of the Act. This notification shall be submitted in writing to the department pursuant to the notification requirements in 40 CFR Section 60.7, 40 CFR Section 61.07, and/or 40 CFR Section 63.9. *567 IAC 23.1(2), 567 IAC 23.1(3), 567 IAC 23.1(4)*

G17. Requirements for Making Changes to Emission Sources That Do Not Require Title V Permit Modification

1. Off Permit Changes to a Source. Pursuant to section 502(b)(10) of the CAAA, the permittee may make changes to this installation/facility without revising this permit if:

- a. The changes are not major modifications under any provision of any program required by section 110 of the Act, modifications under section 111 of the act, modifications under section 112 of the act, or major modifications as defined in 567 IAC Chapter 22.
 - b. The changes do not exceed the emissions allowable under the permit (whether expressed therein as a rate of emissions or in terms of total emissions);
 - c. The changes are not modifications under any provisions of Title I of the Act and the changes do not exceed the emissions allowable under the permit (whether expressed therein as a rate of emissions or as total emissions);
 - d. The changes are not subject to any requirement under Title IV of the Act.
 - e. The changes comply with all applicable requirements.
 - f. For such a change, the permitted source provides to the department and the administrator by certified mail, at least 30 days in advance of the proposed change, a written notification, including the following, which must be attached to the permit by the source, the department and the administrator:
 - i. A brief description of the change within the permitted facility,
 - ii. The date on which the change will occur,
 - iii. Any change in emission as a result of that change,
 - iv. The pollutants emitted subject to the emissions trade
 - v. If the emissions trading provisions of the state implementation plan are invoked, then Title V permit requirements with which the source shall comply; a description of how the emissions increases and decreases will comply with the terms and conditions of the Title V permit.
 - vi. A description of the trading of emissions increases and decreases for the purpose of complying with a federally enforceable emissions cap as specified in and in compliance with the Title V permit; and
 - vii. Any permit term or condition no longer applicable as a result of the change.
- 567 IAC 22.110(1)*

2. Such changes do not include changes that would violate applicable requirements or contravene federally enforceable permit terms and conditions that are monitoring (including test methods), record keeping, reporting, or compliance certification requirements. *567 IAC 22.110(2)*

3. Notwithstanding any other part of this rule, the director may, upon review of a notice, require a stationary source to apply for a Title V permit if the change does not meet the requirements of subrule 22.110(1). *567 IAC 22.110(3)*

4. The permit shield provided in subrule 22.108(18) shall not apply to any change made pursuant to this rule. Compliance with the permit requirements that the source will meet using the emissions trade shall be determined according to requirements of the state implementation plan authorizing the emissions trade. *567 IAC 22.110(4)*

5. No permit revision shall be required, under any approved economic incentives, marketable permits, emissions trading and other similar programs or processes, for changes that are provided for in this permit. *567 IAC 22.108(11)*

G18. Duty to Modify a Title V Permit

1. Administrative Amendment.

- a. An administrative permit amendment is a permit revision that is required to do any of the following:

- i. Correct typographical errors
 - ii. Identify a change in the name, address, or telephone number of any person identified in the permit, or provides a similar minor administrative change at the source;
 - iii. Require more frequent monitoring or reporting by the permittee; or
 - iv. Allow for a change in ownership or operational control of a source where the director determines that no other change in the permit is necessary, provided that a written agreement containing a specific date for transfer of permit responsibility, coverage and liability between the current and new permittee has been submitted to the director.
 - b. The permittee may implement the changes addressed in the request for an administrative amendment immediately upon submittal of the request. The request shall be submitted to the director.
 - c. Administrative amendments to portions of permits containing provisions pursuant to Title IV of the Act shall be governed by regulations promulgated by the administrator under Title IV of the Act.
2. Minor Permit Modification.
- a. Minor permit modification procedures may be used only for those permit modifications that do any of the following:
 - i. Do not violate any applicable requirements
 - ii. Do not involve significant changes to existing monitoring, reporting or recordkeeping requirements in the Title V permit.
 - iii. Do not require or change a case by case determination of an emission limitation or other standard, or increment analysis.
 - iv. Do not seek to establish or change a permit term or condition for which there is no corresponding underlying applicable requirement and that the source has assumed in order to avoid an applicable requirement to which the source would otherwise be subject. Such terms and conditions include any federally enforceable emissions caps which the source would assume to avoid classification as a modification under any provision under Title I of the Act; and an alternative emissions limit approved pursuant to regulations promulgated under section 112(i)(5) of the Act.;
 - v. Are not modifications under any provision of Title I of the Act; and
 - vi. Are not required to be processed as significant modification.
 - b. An application for minor permit revision shall be on the minor Title V modification application form and shall include at least the following:
 - i. A description of the change, the emissions resulting from the change, and any new applicable requirements that will apply if the change occurs.
 - ii. The permittee's suggested draft permit
 - iii. Certification by a responsible official, pursuant to 567 IAC 22.107(4), that the proposed modification meets the criteria for use of a minor permit modification procedures and a request that such procedures be used; and
 - iv. Completed forms to enable the department to notify the administrator and the affected states as required by 567 IAC 22.107(7).
 - c. The permittee may make the change proposed in its minor permit modification application immediately after it files the application. After the permittee makes this

change and until the director takes any of the actions specified in 567 IAC 22.112(4) "a" to "c", the permittee must comply with both the applicable requirements governing the change and the proposed permit terms and conditions. During this time, the permittee need not comply with the existing permit terms and conditions it seeks to modify.

However, if the permittee fails to comply with its proposed permit terms and conditions during this time period, existing permit term terms and conditions it seeks to modify may subject the facility to enforcement action.

3. Significant Permit Modification. Significant Title V modification procedures shall be used for applications requesting Title V permit modifications that do not qualify as minor Title V modifications or as administrative amendments. These include but are not limited to all significant changes in monitoring permit terms, every relaxation of reporting or recordkeeping permit terms, and any change in the method of measuring compliance with existing requirements. Significant Title V modifications shall meet all requirements of 567 IAC Chapter 22, including those for applications, public participation, review by affected states, and review by the administrator, and those requirements that apply to Title V issuance and renewal. *567 IAC 22.111-567 IAC 22.113* The permittee shall submit an application for a significant permit modification not later than three months after commencing operation of the changed source unless the existing Title V permit would prohibit such construction or change in operation, in which event the operation of the changed source may not commence until the department revises the permit. *567 IAC 22.105(1)"a"(4)*

G19. Duty to Obtain Construction Permits

Unless exempted under 567 IAC 22.1(2), the permittee must not construct, install, reconstruct, or alter any equipment, control equipment or anaerobic lagoon without first obtaining a construction permit, conditional permit, or permit pursuant to 567 IAC 22.8, or permits required pursuant to 567 IAC 22.4 and 567 IAC 22.5. Such permits shall be obtained prior to the initiation of construction, installation or alteration of any portion of the stationary source. *567 IAC 22.1(1)*

G20. Asbestos

The permittee shall comply with 567 IAC 23.1(3)"a", and 567 IAC 23.2(3)"g" when activities involve asbestos mills, surfacing of roadways, manufacturing operations, fabricating, insulating, waste disposal, spraying applications, demolition and renovation operations, training fires and controlled burning of a demolished building. *567 IAC 23.1(3)"a", and 567 IAC 23.2*

G21. Open Burning

The permittee is prohibited from conducting open burning, except as may be allowed by 567 IAC 23.2. *567 IAC 23.2 except 23.2(3)"j"; 567 IAC 23.2(3)"j" - State Only*

G22. Acid Rain (Title IV) Emissions Allowances

The permittee shall not exceed any allowances that it holds under Title IV of the Act or the regulations promulgated there under. Annual emissions of sulfur dioxide in excess of the number of allowances to emit sulfur dioxide held by the owners and operators of the unit or the designated representative of the owners and operators is prohibited. Exceedences of applicable emission rates are prohibited. "Held" in this context refers to both those allowances assigned to the owners and operators by USEPA, and those allowances supplementally acquired by the owners and operators. The use of any allowance prior to the year for which it was allocated is prohibited. Contravention of any other provision of the permit is prohibited. *567 IAC 22.108(7)*

G23. Stratospheric Ozone and Climate Protection (Title VI) Requirements

1. The permittee shall comply with the standards for labeling of products using ozone-depleting substances pursuant to 40 CFR Part 82, Subpart E:

- a. All containers in which a class I or class II substance is stored or transported, all products containing a class I substance, and all products directly manufactured with a class I substance must bear the required warning statement if it is being introduced into interstate commerce pursuant to § 82.106.
 - b. The placement of the required warning statement must comply with the requirements pursuant to § 82.108.
 - c. The form of the label bearing the required warning statement must comply with the requirements pursuant to § 82.110.
 - d. No person may modify, remove, or interfere with the required warning statement except as described in § 82.112.
2. The permittee shall comply with the standards for recycling and emissions reduction pursuant to 40 CFR Part 82, Subpart F, except as provided for MVACs in Subpart B:
- a. Persons opening appliances for maintenance, service, repair, or disposal must comply with the required practices pursuant to § 82.156.
 - b. Equipment used during the maintenance, service, repair, or disposal of appliances must comply with the standards for recycling and recovery equipment pursuant to § 82.158.
 - c. Persons performing maintenance, service, repair, or disposal of appliances must be certified by an approved technician certification program pursuant to § 82.161.
 - d. Persons disposing of small appliances, MVACs, and MVAC-like appliances must comply with reporting and recordkeeping requirements pursuant to § 82.166. ("MVAC-like appliance" as defined at § 82.152)
 - e. Persons owning commercial or industrial process refrigeration equipment must comply with the leak repair requirements pursuant to § 82.156.
 - f. Owners/operators of appliances normally containing 50 or more pounds of refrigerant must keep records of refrigerant purchased and added to such appliances pursuant to § 82.166.
3. If the permittee manufactures, transforms, imports, or exports a class I or class II substance, the permittee is subject to all the requirements as specified in 40 CFR part 82, Subpart A, Production and Consumption Controls.
4. If the permittee performs a service on motor (fleet) vehicles when this service involves ozone-depleting substance refrigerant (or regulated substitute substance) in the motor vehicle air conditioner (MVAC), the permittee is subject to all the applicable requirements as specified in 40 CFR part 82, Subpart B, Servicing of Motor Vehicle Air Conditioners. The term "motor vehicle" as used in Subpart B does not include a vehicle in which final assembly of the vehicle has not been completed. The term "MVAC" as used in Subpart B does not include the air-tight sealed refrigeration system used as refrigerated cargo, or system used on passenger buses using HCFC-22 refrigerant,
5. The permittee shall be allowed to switch from any ozone-depleting substance to any alternative that is listed in the Significant New Alternatives Program (SNAP) promulgated pursuant to 40 CFR part 82, Subpart G, Significant New Alternatives Policy Program. *40 CFR part 82*

G24. Permit Reopenings

1. This permit may be modified, revoked, reopened, and reissued, or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or of a notification of planned changes or anticipated noncompliance does not stay any permit condition. *567 IAC 22.108(9)"c"*

2. Additional applicable requirements under the Act become applicable to a major part 70 source with a remaining permit term of 3 or more years. Revisions shall be made as expeditiously as practicable, but not later than 18 months after the promulgation of such standards and regulations.

a. Reopening and revision on this ground is not required if the permit has a remaining term of less than three years;

b. Reopening and revision on this ground is not required if the effective date of the requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms and conditions have been extended pursuant to 40 CFR 70.4(b)(10)(i) or (ii) as amended to May 15, 2001.

c. Reopening and revision on this ground is not required if the additional applicable requirements are implemented in a general permit that is applicable to the source and the source receives approval for coverage under that general permit. *567 IAC 22.108(17)"a", 567 IAC 22.108(17)"b"*

3. A permit shall be reopened and revised under any of the following circumstances:

a. The department receives notice that the administrator has granted a petition for disapproval of a permit pursuant to 40 CFR 70.8(d) as amended to July 21, 1992, provided that the reopening may be stayed pending judicial review of that determination;

b. The department or the administrator determines that the Title V permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of the Title V permit;

c. Additional applicable requirements under the Act become applicable to a Title V source, provided that the reopening on this ground is not required if the permit has a remaining term of less than three years, the effective date of the requirement is later than the date on which the permit is due to expire, or the additional applicable requirements are implemented in a general permit that is applicable to the source and the source receives approval for coverage under that general permit. Such a reopening shall be complete not later than 18 months after promulgation of the applicable requirement.

d. Additional requirements, including excess emissions requirements, become applicable to a Title IV affected source under the acid rain program. Upon approval by the administrator, excess emissions offset plans shall be deemed to be incorporated into the permit.

e. The department or the administrator determines that the permit must be revised or revoked to ensure compliance by the source with the applicable requirements. *567 IAC 22.114(1)*

4. Proceedings to reopen and reissue a Title V permit shall follow the procedures applicable to initial permit issuance and shall effect only those parts of the permit for which cause to reopen exists. *567 IAC 22.114(2)*

G25. Permit Shield

1. The director may expressly include in a Title V permit a provision stating that compliance with the conditions of the permit shall be deemed compliance with any applicable requirements as of the date of permit issuance, provided that:

a. Such applicable requirements are included and are specifically identified in the permit;
or

- b. The director, in acting on the permit application or revision, determines in writing that other requirements specifically identified are not applicable to the source, and the permit includes the determination or a concise summary thereof.
2. A Title V permit that does not expressly state that a permit shield exists shall be presumed not to provide such a shield.
3. A permit shield shall not alter or affect the following:
 - a. The provisions of Section 303 of the Act (emergency orders), including the authority of the administrator under that section;
 - b. The liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance;
 - c. The applicable requirements of the acid rain program, consistent with Section 408(a) of the Act;
 - d. The ability of the department or the administrator to obtain information from the facility pursuant to Section 114 of the Act. *567 IAC 22.108 (18)*

G26. Severability

The provisions of this permit are severable and if any provision or application of any provision is found to be invalid by this department or a court of law, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected by such finding. *567 IAC 22.108 (8)*

G27. Property Rights

The permit does not convey any property rights of any sort, or any exclusive privilege. *567 IAC 22.108 (9)"d"*

G28. Transferability

This permit is not transferable from one source to another. If title to the facility or any part of it is transferred, an administrative amendment to the permit must be sought to determine transferability of the permit. *567 IAC 22.111 (1)"d"*

G29. Disclaimer

No review has been undertaken on the engineering aspects of the equipment or control equipment other than the potential of that equipment for reducing air contaminant emissions. *567 IAC 22.3(3)"c"*

G30. Notification and Reporting Requirements for Stack Tests or Monitor Certification

The permittee shall notify the department's stack test contact in writing not less than 30 days before a required test or performance evaluation of a continuous emission monitor is performed to determine compliance with applicable requirements of 567 – Chapter 23 or a permit condition. For the department to consider test results a valid demonstration of compliance with applicable rules or a permit condition, such notice shall be given. Such notice shall include the time, the place, the name of the person who will conduct the test and other information as required by the department. Unless specifically waived by the department's stack test contact, a pretest meeting shall be held not later than 15 days prior to conducting the compliance demonstration. The department may accept a testing protocol in lieu of a pretest meeting. A representative of the department shall be permitted to witness the tests. Results of the tests shall be submitted in writing to the department's stack test contact in the form of a comprehensive report within six weeks of the completion of the testing. Compliance tests conducted pursuant to this permit shall be conducted with the source operating in a normal manner at its maximum continuous output as rated by the equipment manufacturer, or the rate specified by the owner as the maximum production rate at which the source shall be operated. In cases where compliance is to be

demonstrated at less than the maximum continuous output as rated by the equipment manufacturer, and it is the owner's intent to limit the capacity to that rating, the owner may submit evidence to the department that the source has been physically altered so that capacity cannot be exceeded, or the department may require additional testing, continuous monitoring, reports of operating levels, or any other information deemed necessary by the department to determine whether such source is in compliance.

Stack test notifications, reports and correspondence shall be sent to:

Stack Test Review Coordinator
Iowa DNR, Air Quality Bureau
7900 Hickman Road, Suite #1
Windsor Heights, IA 50324
(515) 242-6001

Within Polk and Linn Counties, stack test notifications, reports and correspondence shall also be directed to the supervisor of the respective county air pollution program.

567 IAC 25.1(7)"a", 567 IAC 25.1(9)

G31. Prevention of Air Pollution Emergency Episodes

The permittee shall comply with the provisions of 567 IAC Chapter 26 in the prevention of excessive build-up of air contaminants during air pollution episodes, thereby preventing the occurrence of an emergency due to the effects of these contaminants on the health of persons.

567 IAC 26.1(1)

G32. Contacts List

The current address and phone number for reports and notifications to the EPA administrator is:

Chief of Air Permits
EPA Region 7
Air Permits and Compliance Branch
901 N. 5th Street
Kansas City, KS 66101
(913) 551-7020

The current address and phone number for reports and notifications to the department or the Director is:

Chief, Air Quality Bureau
Iowa Department of Natural Resources
7900 Hickman Road, Suite #1
Windsor Heights, IA 50324
(515) 242-5100

Reports or notifications to the DNR Field Offices or local programs shall be directed to the supervisor at the appropriate field office or local program. Current addresses and phone numbers are:

Field Office 1

909 West Main – Suite 4
Manchester, IA 52057
(563) 927-2640

Field Office 2

2300-15th St., SW
Mason City, IA 50401
(641) 424-4073

Field Office 3

1900 N. Grand Ave.
Spencer, IA 51301
(712) 262-4177

Field Office 4

1401 Sunnyside Lane
Atlantic, IA 50022
(712) 243-1934

Field Office 5

401 SW 7th Street, Suite I
Des Moines, IA 50309
(515) 725-0268

Field Office 6

1023 West Madison Street
Washington, IA 52353-1623
(319) 653-2135

Polk County Public Works Dept.

Air Quality Division
5885 NE 14th St.
Des Moines, IA 50313
(515) 286-3351

Linn County Public Health Dept.

Air Pollution Control Division
501 13th St., NW
Cedar Rapids, IA 52405
(319) 892-6000

V. Appendix A: CAM Plan for Main Plant Boiler (EU 17)

**Compliance Assurance Monitoring Plan
Electrostatic Precipitator for PM10/PM Control**

Facility:	IPL/ Burlington Generating Station
EQ Number:	92-2773
Emission Unit Description:	Dry Bottom Pulverized, T-Fired Boiler
Emission Unit Identification:	EU 17
Emission Point Identification:	EP 17
Control Equipment Identification:	CE 01
Control Technology:	Electrostatic Precipitator
Emission Limits (PM10):	0.559 lb/MMBtu 1161.0 lb/hr 5085.4 tons/yr
Emission Limit (PM):	0.8 lb/MMBtu
Authority for PM/PM10 Requirements:	IDNR Construction Permit 93-A-390-S10
Current Monitoring Requirements:	Continuous Opacity Monitoring and TR Set Monitoring

This Compliance Assurance Monitoring (CAM) plan was prepared pursuant to 40 CFR Part 64. It represents the monitoring requirements for the electrostatic precipitator (ESP) for boiler EU 17 to provide a reasonable assurance of compliance with the unit's PM10 and PM emission limits. These monitoring requirements were established through several performance stack tests conducted in June 2001 and May 2004, and consist of boiler load, ESP operation parameters and opacity. These results have indicated that, during normal operations, PM10 and PM emission were 17% and 14% of the permit limit of 0.559 and 0.8 lb/mmbtu respectively. In addition, PM10 emission will trigger PM10 limit before PM emission triggers PM limit. Therefore, ensuring compliance with the PM10 limit will warrant compliance with the PM limit.

General

IPL/Burlington Generating Station shall conduct opacity and load vs. emission monitoring in continuous operation at all times that boiler EU 17 is operating except for, as applicable, monitoring malfunctions, associated repairs, and required quality assurance or control activities as stated in the Title V permit. Emission unit 17 startup and shutdown time periods are exempted from this CAM requirement.

As approved by the IDNR, startup is defined as the time beginning when a fire is established and ending when the unit reaches the minimum safe stable load as identified in RT 536 of the quarterly electronic data report (EDR) and required in 40 CFR 75 Appendix A, Section 6.5.2.1. Shutdown is defined as the period beginning when a unit goes below the minimum safe stable load and ending when the boiler "time-on-line" signal shows the unit is off.

Load vs. Emission CAM Indicator

The boiler will be operated based on the charts of Load vs. Emission under different conditions of TR setting or ESP section in service. The charts are included as Appendices 1 (p. 100) and 2 (p. 102).

The TR setting and/or ESP section conditions will be monitored continuously through the control room computer. When certain TR sets are off or certain ESP sections are out of service, the boiler load will be adjusted by the operators according to the charts.

Whenever TR sections are out of service, Burlington Generating Station will document to demonstrate compliance with the PM10 limits using the charts of load vs. emission.

Excursions are triggered when the chart-predicted PM10 emissions are higher than the PM10 limits. Burlington Generating Station shall document all excursions accordingly.

All excursions will be documented using the CAM event documentation sheet, included in Appendix 3 (p. 104).

Opacity CAM Indicator

Burlington Generating Station will use opacity as another CAM indicator and will continuously monitor and record opacity. The opacity shall be monitored and recorded using the Continuous Opacity Monitoring (COM) system. COM shall follow 40 CFR Part 60 requirements.

The current 6-minute opacity data will be used to calculate a one-hour average which will be compared to a pre-determined excursion point. To be consistent with 40 CFR 60 requirements, opacity CAM indicator excursions shall not apply during EU17 startup and shut down and malfunction time periods.

The opacity CAM indicator range is less than or equal to 40% and the excursion point is greater than 40% opacity. Excursions are triggered when the opacity CAM indicator exceeds 40%. Burlington Generating Station will document all excursion events using the CAM event documentation sheet, included as Appendix 3 (p. 104).

In the event the opacity monitor malfunctions for a period greater than 8 hours, Burlington Generating Station will contact the IDNR. During these periods of monitor malfunction, the load versus emissions chart will be used to ensure compliance.

Quality Improvement Plan (QIP)

A Quality Improvement Plan (QIP) will be required if an accumulation of excursions of either the load CAM indicators or opacity CAM indicator exceeds 5 percent of boiler EU 17's normal operating time for a 6-month reporting period. All the requirements in 40 CFR 64.8(b) shall be fulfilled if a QIP plan is required.

Quality Assurance and Quality Control

In addition to the load and opacity indicators, Burlington Generating Station will conduct the following activities to assure compliance.

Weekly Inspections

- Inspection of ash hopper and overall ash system operation.

Corrective action measures will be implemented on the occurrence of an abnormal condition. Indications of abnormal operating parameters will trigger a maintenance work order request. The maintenance work request system establishes a work priority to ensure that work on the ESP, or its control system, is performed as soon as possible, considering the unit's need to provide electricity to meet customer demand.

Annual Inspection of the Electrostatic Precipitator

- Inspect plate and electrode alignment and adjust if necessary.
- Check plates and electrodes for excess fouling and signs of corrosion.
- Check the TR set mechanical condition.
- Inspect the insulator housings for mechanical condition.
- Inspect internal structural components for signs of corrosion, air leakage, and mechanical failure.

Corrective actions will be implemented in a timely manner based on the findings of the inspection.

Record Keeping and Reporting

- Opacity reports and supporting data will be kept in accordance with 567 IAC 25.
- Records of all planned unit outage inspections and any actions resulting from these inspections will be kept for five years.
- Whenever an excursion is triggered, Burlington Generating Station will document the duration and cause (including unknown cause) of the excursion and the corrective actions taken.
- All excursions will be reported in semi-annual monitoring reports and annual compliance certifications.

Authority for Requirement: 567 IAC 22.108(3)
40 CFR 64

Appendix 1 to the CAM Plan for Main Plant Boiler

Load vs. PM10 Emissions (lb/MMbtu) Chart

Appendix 2 to the CAM Plan for Main Plant Boiler

Load vs. PM10 Emissions (lb/hour) Chart

Appendix 3 to the CAM Plan for Main Plant Boiler

CAM Event Form

CAM Event Form Burlington Generating Station

Purpose: Provide documentation of compliance assurance monitoring (CAM) event when having 2 or more ESP TR sections are in outage (see instructions when half RT sections are in outage) and/or opacity exceeding 40% (one hour average). Both events to be applied to this form will be indicated by the computer alarm system.

Note: This form shall be used only when control room alarm is triggered. Please do not use it for boiler startup/shutdown period exceedances.

Completed by Operator			
Operator Name: _____			
1. Date: _____	2. Event Start Time: _____	Event End Time: _____	Event Total Time: _____, Minutes
3. Alarmed CAM Indicator: <input type="checkbox"/> Load vs. Emission at _____ MW (gross), fill in 4 thru 8 . <input type="checkbox"/> Opacity at _____ % (1-hr Ave), fill in 6 thru 8			
4. Indicate TR Section Outage(s): <input type="checkbox"/> 1 <input type="checkbox"/> 2 <input type="checkbox"/> 3 <input type="checkbox"/> 4 <input type="checkbox"/> 5 <input type="checkbox"/> 6 <input type="checkbox"/> 7 <input type="checkbox"/> 8 <input type="checkbox"/> 9 <input type="checkbox"/> 10			
5. Enter PM10 values from the attached Load vs. Emission Charts: _____ (lb/mmBtu), _____ (lb/hr)			
6. Alarm/Malfunction Cause(s): <input type="checkbox"/> Boiler Upset; <input type="checkbox"/> Boiler Adjustment; <input type="checkbox"/> Soot Blowing; <input type="checkbox"/> Control Equipment (ESP, etc.); <input type="checkbox"/> Other _____			
7. Corrective Action(s): <input type="checkbox"/> Drop load to _____ Gross MW; <input type="checkbox"/> Reset TR ; <input type="checkbox"/> Fuel Adjustment; <input type="checkbox"/> Other _____			
8. <input type="checkbox"/> Give to Plant Environmental and Safety Specialist once complete.			
Completed by E&S Specialist			
1. Date: _____	Time: _____	Name: _____	
2. PM-10 Emission Rate During Alarming Time (Load vs Emissions only): _____ <input type="checkbox"/> lb/MMBtu, if ≥ 0.559 , go to 3 . Otherwise, stop here and keep the record. _____ <input type="checkbox"/> lb/hr, if ≥ 1161 , go to 3 . Otherwise, stop here and keep the record.			
3. Total excursion hours this 6 month reporting period so far: L. vs. E _____ hr. Opacity _____ hr.			
4. Calculate % of excursion (s) for 6-month reporting period: L. vs. E _____%; Opacity _____%			
5. Does either of them exceed 5% for this 6 month reporting period? <input type="checkbox"/> Yes, go to 6 . <input type="checkbox"/> No, go to 7			
6. Initiate and submit QIP to the IDNR (Support provided by Air Specialist)			
7. Report in semi-annual report and annual certification.			
Plant Environmental and Safety Specialist Comments:			
E & S Signature: _____			

*See back for Instructions

The following is the instructions on how to use the lb/hr vs load and lbs/mmbtu vs load charts. When in alarm, both the lb/hr vs load chart and lbs/mmbtu vs load chart need to be checked. Operator will fill out items 1 through 8 on the CAM Event form.

1. Date – Date of the alarm
2. Event Start at (time the alarm comes in); Event End Time (time event ends); Event Total Time (total minutes of event) Minutes.
3. Alarmed CAM Indicator
 - a. Put a check in the Load vs. Emission check box.
 - b. Insert the Gross MW on line.
4. Insert an “X” in the correct TR Section Outage boxes. Insert a “/” if only half of TR section is in outage. After the boxes have been checked, go to ESP Section Outage of the chart and find the TR outage that matches the current TR outage. (see “a.” through “d.” below for half-section outages)
 - a. If there is a half-section outage in Sections 1-8, count the outage as a whole section outage.
 - b. If there are two half-section outages of the ESP in Sections 1-8, then count that as one whole section outage.
 - c. If there are three half-section outages of the ESP in Sections 1-8, then count that as two whole section outages (i.e., round up to the next higher outage number).
 - d. For outlet sections 9 and 10, if you lose half a section, count the entire section as an outage since there is no further collection behind it.

Electrostatic Precipitator TR Sections

9		10	
5	6	7	8
1	2	3	4

5. Once TR is established, go to the right to find the recorded MW column. The reportable emission rate will be where the TR and MW meet. Fill this number in the provided space.
6. Alarm/Malfunction Cause(s) – Check the appropriate box or fill in.
7. Corrective Action (s) – Check the appropriate box or fill in.
8. Give to Plant Environmental and Safety Specialist once complete.

VI. Appendix B: Acid Rain Phase II Permit & CAIR Permit

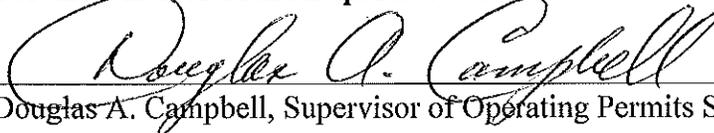


AIR QUALITY BUREAU
7900 Hickman Rd., Suite 1
Windsor Heights, IA 50324


Phase II Acid Rain Permit

Issued to: IPL/Burlington Generating Station
Operated by: Alliant Energy
ORIS code: 1104
Effective: March 23, 2012 through March 22, 2017

For the Director of the Department of Natural Resources



Douglas A. Campbell, Supervisor of Operating Permits Section



Date

Acid Rain Permit comprises the following:

- 1) Statement of Basis.
- 2) SO₂ allowances allocated under this permit and NO_x requirements for each affected unit.
- 3) Comments, notes and justifications regarding permit decisions and changes made to the permit application forms during the review process, and any additional requirements or conditions.
- 4) The permit application submitted for this source, as corrected by the Iowa Department of Natural Resources (IDNR), Air Quality Bureau, Operating Permit Section. The owners and operators of the source must comply with the standard requirements and special provisions set forth in the application.

1) Statement of Basis

Statutory and Regulatory Authorities: In accordance with Iowa Code paragraph 455B.133[8"a"], and Titles IV and V of the Clean Air Act, the Iowa Department of Natural Resources (IDNR), Air Quality Bureau, Operating Permit Section issues this permit pursuant to 567 Iowa Administrative Code (IAC) 22.135(455B) to 22.145(455B) and 567 IAC 22.100(455B) to 22.116(455B). The compliance options are approved as proposed in the attached application.

2) SO₂ Allowance Allocations and NO_x Requirements for each affected unit

		2012	2013	2014	2015	2016	2017
Unit 1	SO ₂ allowances, under Table 2 of 40 CFR part 73.	4507*	4507*	4507*	4507*	4507*	4507*
	NO _x limit (Averaging Plan through Dec. 31, 2015)	<p>Pursuant to 40 CFR part 76, The Iowa Department of Natural Resources approves a NO_x compliance plan which includes an emission averaging plan for Unit 1. The NO_x emission averaging plan is effective from January 1, 2011 through December 31, 2015. Under the NO_x averaging plan, this unit's annual average NO_x emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the alternative contemporaneous annual emission limitation of 0.40 lbs/mmBtu, and this unit's actual annual heat input shall not be less than the annual heat input of 12,772,395 mmBtu.</p> <p>The other units in the averaging plan are Prairie Creek Unit 3, Milton L. Kapp Unit 2, Dubuque Unit 1, Dubuque Unit 5, Lansing Unit 3 and Lansing Unit 4. For each year under the plan, the actual Btu-weighted annual average emission rate for the units in the plan shall be less than or equal to the Btu-weighted annual average emission rate for the same units had they each been operated, during the same period of time, in compliance with the applicable emission limitation in 40 CFR 76.5. If the designated representative demonstrates that the requirement of the prior sentence (as set forth in 40 CFR 76.11(d)(1)(ii)(A) and (B)) is met for a year under the plan, then this unit shall be deemed to be in compliance for that year with its alternative contemporaneous emission limitation and annual heat input limit.</p> <p>On January 1, 2016, under the remainder of the NO_x compliance plan, this unit's annual average NO_x emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the applicable emission limitation under 40 CFR 76.5(a)(1), which is 0.45 lbs/mmBtu for tangentially fired units.</p> <p>In addition to the described NO_x compliance plan, this unit shall comply with all other applicable requirements of 40 CFR Part 76, including the duty to reapply for a NO_x averaging plan and the requirements covering excess emissions.</p>					

* The number of allowances allocated to Phase II affected units by U.S. EPA in 40 CFR part 73 Table 2 (Revised May 12, 2005). In addition, the number of allowances actually held by an affected source in a unit account may differ from the number allocated by U.S. EPA. Neither of

the aforementioned conditions necessitate a revision to the unit SO₂ allowance allocations identified in this permit (See 40 CFR 72.84).

3) Comments, Notes and Justifications:

Renewal of the Phase II SO₂ and NO_x permit.

The NO_x Averaging Plan portion of this Phase II Permit will cover the period from January 1, 2011 through December 31, 2015 (IDNR). On January 1, 2016 the NO_x emission limit changes to the Revised NO_x emission limitations for Group 1, Phase I boilers (40 CFR 76.5). An application for a new averaging plan must be submitted no later than January 1, 2016 (See 40 CFR 76.11(b)(1)) in lieu of complying with the Revised NO_x emission limitations for Group 1, Phase I boilers (40 CFR 76.5).

4) Permit Application: Attached.

Permit Requirements**STEP 3**

Read the standard requirements.

(1) The designated representative of each affected source and each affected unit at the source shall:

(i) Submit a complete Acid Rain permit application (including a compliance plan) under 40 CFR part 72 in accordance with the deadlines specified in 40 CFR 72.30; and

(ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain permit application and issue or deny an Acid Rain permit;

(2) The owners and operators of each affected source and each affected unit at the source shall:

(i) Operate the unit in compliance with a complete Acid Rain permit application or a superseding Acid Rain permit issued by the permitting authority; and

(ii) Have an Acid Rain Permit.

Monitoring Requirements

(1) The owners and operators and, to the extent applicable, designated representative of each affected source and each affected unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75.

(2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the source or unit, as appropriate, with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.

(3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

(1) The owners and operators of each source and each affected unit at the source shall:

(i) Hold allowances, as of the allowance transfer deadline, in the source's compliance account (after deductions under 40 CFR 73.34(c)), not less than the total annual emissions of sulfur dioxide for the previous calendar year from the affected units at the source; and

(ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.

(2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.

(3) An affected unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:

(i) Starting January 1, 2000, an affected unit under 40 CFR 72.6(a)(2); or

(ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an affected unit under 40 CFR 72.6(a)(3).

Sulfur Dioxide Requirements, Cont'd.

STEP 3, Cont'd.

(4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.

(5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.

(6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.

(7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements

The owners and operators of the source and each affected unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

(1) The designated representative of an affected source that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.

(2) The owners and operators of an affected source that has excess emissions in any calendar year shall:

(i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and

(ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

(1) Unless otherwise provided, the owners and operators of the source and each affected unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:

(i) The certificate of representation for the designated representative for the source and each affected unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with 40 CFR 72.24; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;

Recordkeeping and Reporting Requirements, Cont'd.

STEP 3, Cont'd.

- (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply.
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,
 - (iv) Copies of all documents used to complete an Acid Rain permit application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an affected source and each affected unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability

- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each affected source and each affected unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an affected source (including a provision applicable to the designated representative of an affected source) shall also apply to the owners and operators of such source and of the affected units at the source.
- (6) Any provision of the Acid Rain Program that applies to an affected unit (including a provision applicable to the designated representative of an affected unit) shall also apply to the owners and operators of such unit.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 74, 75, 76, 77, and 78 by an affected source or affected unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities

No provision of the Acid Rain Program, an Acid Rain permit application, an Acid Rain permit, or an exemption under 40 CFR 72.7 or 72.8 shall be construed as:

- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an affected source or affected unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating

Effect on Other Authorities, Cont'd.

STEP 3, Cont'd.

to applicable National Ambient Air Quality Standards or State Implementation Plans;

(2) Limiting the number of allowances a source can hold; *provided*, that the number of allowances held by the source shall not affect the source's obligation to comply with any other provisions of the Act;

(3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;


(4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,

(5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

STEP 4
Read the certification statement, sign, and date.

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name John O Larsen	
Signature 	Date NOV. 11, 2008

Plant Name (from Step 1) Burlington Generating Station

STEP 2, cont'd.

	ID# 1	ID#	ID#	ID#	ID#	ID#
	Type T	Type	Type	Type	Type	Type
(m) EPA-approved common stack apportionment method pursuant to 40 CFR 75.17(a)(2)(I)(C), (a)(2)(II)(B), or (b)(2)	<input type="checkbox"/>					
(n) AEL (include Phase II AEL Demonstration Period, Final AEL Petition, or AEL Renewal form as appropriate)	<input type="checkbox"/>					
(o) Petition for AEL demonstration period or final AEL under review by U.S. EPA or demonstration period ongoing	<input type="checkbox"/>					
(p) Repowering extension plan approved or under review	<input type="checkbox"/>					

STEP 3
 Read the standard requirements and certification, enter the name of the designated representative, sign &

Standard Requirements

General. This source is subject to the standard requirements in 40 CFR 72.9 (consistent with 40 CFR 76.8(e)(1)(i)). These requirements are listed in this source's Acid Rain Permit.

Special Provisions for Early Election Units

Nitrogen Oxides. A unit that is governed by an approved early election plan shall be subject to an emissions limitation for NO_x as provided under 40 CFR 76.8(a)(2) except as provided under 40 CFR 76.8(e)(3)(iii).

Liability. The owners and operators of a unit governed by an approved early election plan shall be liable for any violation of the plan or 40 CFR 76.8 at that unit. The owners and operators shall be liable, beginning January 1, 2000, for fulfilling the obligations specified in 40 CFR Part 77.

Termination. An approved early election plan shall be in effect only until the earlier of January 1, 2008 or January 1 of the calendar year for which a termination of the plan takes effect. If the designated representative of the unit under an approved early election plan fails to demonstrate compliance with the applicable emissions limitation under 40 CFR 76.5 for any year during the period beginning January 1 of the first year the early election takes effect and ending December 31, 2007, the permitting authority will terminate the plan. The termination will take effect beginning January 1 of the year after the year for which there is a failure to demonstrate compliance, and the designated representative may not submit a new early election plan. The designated representative of the unit under an approved early election plan may terminate the plan any year prior to 2008 but may not submit a new early election plan. In order to terminate the plan, the designated representative must submit a notice under 40 CFR 72.40(d) by January 1 of the year for which the termination is to take effect. If an early election plan is terminated any year prior to 2000, the unit shall meet, beginning January 1, 2000, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7. If an early election plan is terminated on or after 2000, the unit shall meet, beginning on the effective date of the termination, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7.

Certification

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name John O. Larsen	
Signature	Date 3-24-11

[Empty box]

STEP 3

This plan is effective for calendar year 2011 through calendar year 2015

unless notification to terminate the plan is given.

Mark one of the two options and enter dates.

Treat this plan as identical plans, each effective for one calendar year for the following calendar years: _____, _____, _____, _____ and _____ unless notification to terminate one or more of these plans is given.

STEP 4

Special Provisions

Read the special provisions and certification, enter the name of the designated representative, and sign and date.

Emission Limitations

Each affected unit in an approved averaging plan is in compliance with the Acid Rain emission limitation for NO_x under the plan only if the following requirements are met:

- (i) For each unit, the unit's actual annual average emission rate for the calendar year, in lb/mmBtu, is less than or equal to its alternative contemporaneous annual emission limitation in the averaging plan, and
 - (a) For each unit with an alternative contemporaneous emission limitation less stringent than the applicable emission limitation in 40 CFR 76.5, 76.6, or 76.7, the actual annual heat input for the calendar year does not exceed the annual heat input limit in the averaging plan,
 - (b) For each unit with an alternative contemporaneous emission limitation more stringent than the applicable emission limitation in 40 CFR 76.5, 76.6, or 76.7, the actual annual heat input for the calendar year is not less than the annual heat input limit in the averaging plan, or
- (ii) If one or more of the units does not meet the requirements of (i), the designated representative shall demonstrate, in accordance with 40 CFR 76.11(d)(1)(ii)(A) and (B), that the actual Btu-weighted annual average emission rate for the units in the plan is less than or equal to the Btu-weighted annual average rate for the same units had they each been operated, during the same period of time, in compliance with the applicable emission limitations in 40 CFR 76.5, 76.6, or 76.7.
- (ii) If there is a successful group showing of compliance under 40 CFR 76.11(d)(1)(ii)(A) and (B) for a calendar year, then all units in the averaging plan shall be deemed to be in compliance for that year with their alternative contemporaneous emission limitations and annual heat input limits under (i).

Liability


The owners and operators of a unit governed by an approved averaging plan shall be liable for any violation of the plan or this section at that unit or any other unit in the plan, including liability for fulfilling the obligations specified in part 77 of this chapter and sections 113 and 411 of the Act.

Termination

The designated representative may submit a notification to terminate an approved averaging plan, in accordance with 40 CFR 72.40(d), no later than October 1 of the calendar year for which the plan is to be terminated.

Certification

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name John O Larsen	
Signature 	Date 3-24-11



AIR QUALITY BUREAU
7900 Hickman Rd., Suite 1
Windsor Heights, IA 50324

Clean Air Interstate Rule (CAIR) Permit

Issued to: IPL/Burlington Generating Station
Operated by: Alliant Energy
ORIS code: 1104
Effective: March 23, 2012 through March 22, 2017

For the Director of the Department of Natural Resources

Douglas A. Campbell, Supervisor of Operating Permits Section

3/23/2012

Date

Clean Air Interstate Rule (CAIR) Permit comprises the following:

- 1) Statement of Basis.
- 2) Nitrogen Oxide (NO_x) annual and ozone season allowances allocated under this permit for each affected unit. Sulfur Dioxide (SO₂) allowances are allocated under the Acid Rain Program for units affected under that program. Under the CAIR program the SO₂ allowances will have different values depending on the date of reconciliation.
- 3) Comments, notes and justifications regarding permit decisions and changes made to the permit application forms during the review process, and any additional requirements or conditions.
- 4) The permit application submitted for this source, as corrected by the Iowa Department of Natural Resources (IDNR), Air Quality Bureau, Operating Permit Section. The owners and operators of the source must comply with the standard requirements and special provisions set forth in the application.

1) Statement of Basis

Statutory and Regulatory Authorities: In accordance with Iowa Code Chapter 455B, and Title I of the Clean Air Act, the Iowa Department of Natural Resources (IDNR), Air Quality Bureau, Operating Permit Section issues this permit pursuant to 567 Iowa Administrative Code (IAC) 34.203(455B) NO_x Annual, 34.223(455B) NO_x Ozone Season, SO₂ Annual 34.210(455B) and 567 IAC 22.100(455B) to 22.116(455B). The compliance options are approved as proposed in the attached application.

2) NO_x Annual and NO_x Ozone Season allowance allocations and SO₂ requirements for each affected unit.

		2012	2013	2014	2015	2016	2017
Unit 1	NO _x Annual Allowances under Table 1A of 567 IAC 34.205(2)	1151*	1151*	1151*	979*	979*	979*
	NO _x Ozone Season Allowances under Table 2A of 567 IAC 34.225(2)	549*	549*	549*	467*	467*	467*
	SO ₂ allowances requirements are effective January 1, 2010	Sulfur Dioxide (SO ₂) allowances are allocated under the Acid Rain Program for units affected under that program (Table 2 of 40 CFR Part 73). The number of allowances actually held by an affected source in a unit account may differ from the number allocated by U.S. EPA. The aforementioned condition does not necessitate a revision to the unit SO ₂ Annual allowance allocations identified in this permit (See 40 CFR 96.223(b)). Under the CAIR program the SO ₂ allowances will have different values depending on the date of reconciliation (40 CFR 96.202).					

*The number of allowances actually held by an affected source in a unit account may differ from the number the IDNR has instructed EPA to allocate. The aforementioned condition does not necessitate a revision to the unit NO_x Annual or NO_x Ozone Season allowance allocations identified in this permit (See 40 CFR 96.123(b) for NO_x Annual and 40 CFR 96.323(b) NO_x Ozone Season).

3) Comments, Notes and Justifications: Boiler 1 is an affected unit under the Acid Rain program and an affected unit under CAIR. This unit is required to acquire allowances to cover the NO_x Annual, NO_x Ozone Season and SO₂ emissions.

4) Permit Application: Attached.

Plant Name (from Step 1) **Burlington Generating Station**

**STEP 3,
continued**

(b) Monitoring, reporting, and recordkeeping requirements.

(1) The owners and operators, and the CAIR designated representative, of each CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) and each CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) at the source shall comply with the monitoring, reporting, and recordkeeping requirements of subparts HH, HHH, and HHHH (as applicable) of 40 CFR part 96.

(2) The emissions measurements recorded and reported in accordance with subparts HH, HHH, and HHHH (as applicable) of 40 CFR part 96 shall be used to determine compliance by each CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) with the CAIR NO_x emissions limitation, CAIR SO₂ emissions limitation, and CAIR NO_x Ozone Season emissions limitation (as applicable) under paragraph (c) of §96.106, §96.206, and §96.306 (as applicable).

(c) Nitrogen oxides emissions requirements.

(1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR NO_x source and each CAIR NO_x unit at the source shall hold, in the source's compliance account, CAIR NO_x allowances available for compliance deductions for the control period under §96.154(a) in an amount not less than the tons of total nitrogen oxides emissions for the control period from all CAIR NO_x units at the source, as determined in accordance with subpart HH of 40 CFR part 96.

(2) A CAIR NO_x unit shall be subject to the requirements under paragraph (c)(1) of §96.106 for the control period starting on the later of January 1, 2009 or the deadline for meeting the unit's monitor certification requirements under §96.170(b)(1), (2), or (5) and for each control period thereafter.

(3) A CAIR NO_x allowance shall not be deducted, for compliance with the requirements under paragraph (c)(1) of §96.106, for a control period in a calendar year before the year for which the CAIR NO_x allowance was allocated.

(4) CAIR NO_x allowances shall be held in, deducted from, or transferred into or among CAIR NO_x Allowance Tracking System accounts in accordance with subparts FF, GG, and II of 40 CFR part 96.

(5) A CAIR NO_x allowance is a limited authorization to emit one ton of nitrogen oxides in accordance with the CAIR NO_x Annual Trading Program. No provision of the CAIR NO_x Annual Trading Program, the CAIR permit application, the CAIR permit, or an exemption under §96.105 and no provision of law shall be construed to limit the authority of the State or the United States to terminate or limit such authorization.

(6) A CAIR NO_x allowance does not constitute a property right.

(7) Upon recordation by the Administrator under subpart EE, FF, GG, or II of 40 CFR part 96, every allocation, transfer, or deduction of a CAIR NO_x allowance to or from a CAIR NO_x source's compliance account is incorporated automatically in any CAIR permit of the source that includes the CAIR NO_x unit.

Sulfur dioxide emission requirements.

(1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR SO₂ source and each CAIR SO₂ unit at the source shall hold, in the source's compliance account, a tonnage equivalent of CAIR SO₂ allowances available for compliance deductions for the control period under §96.254(a) and (b) not less than the tons of total sulfur dioxide emissions for the control period from all CAIR SO₂ units at the source, as determined in accordance with subpart HHH of 40 CFR part 96.

(2) A CAIR SO₂ unit shall be subject to the requirements under paragraph (c)(1) of §96.206 for the control period starting on the later of January 1, 2010 or the deadline for meeting the unit's monitor certification requirements under §96.270(b)(1), (2), or (5) and for each control period thereafter.

(3) A CAIR SO₂ allowance shall not be deducted, for compliance with the requirements under paragraph (c)(1) of §96.206, for a control period in a calendar year before the year for which the CAIR SO₂ allowance was allocated.

(4) CAIR SO₂ allowances shall be held in, deducted from, or transferred into or among CAIR SO₂ Allowance Tracking System accounts in accordance with subparts FFF, GGG, and III of 40 CFR part 96.

(5) A CAIR SO₂ allowance is a limited authorization to emit sulfur dioxide in accordance with the CAIR SO₂ Trading Program. No provision of the CAIR SO₂ Trading Program, the CAIR permit application, the CAIR permit, or an exemption under §96.205 and no provision of law shall be construed to limit the authority of the State or the United States to terminate or limit such authorization.

(6) A CAIR SO₂ allowance does not constitute a property right.

(7) Upon recordation by the Administrator under subpart FFF, GGG, or III of 40 CFR part 96, every allocation, transfer, or deduction of a CAIR SO₂ allowance to or from a CAIR SO₂ source's compliance account is incorporated automatically in any CAIR permit of the source that includes the CAIR SO₂ unit.

Nitrogen oxides ozone season emissions requirements.

(1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall hold, in the source's compliance account, CAIR NO_x Ozone Season allowances available for compliance deductions for the control period under §96.354(a) in an amount not less than the tons of total nitrogen oxides emissions for the control period from all CAIR NO_x Ozone Season units at the source, as determined in accordance with subpart HHHH of 40 CFR part 96.

(2) A CAIR NO_x Ozone Season unit shall be subject to the requirements under paragraph (c)(1) of §96.306 for the control period starting on the later of May 1, 2009 or the deadline for meeting the unit's monitor certification requirements under §96.370(b)(1), (2), (3) or (7) and for each control period thereafter.

(3) A CAIR NO_x Ozone Season allowance shall not be deducted, for compliance with the requirements under paragraph (c)(1) of §96.306, for a control period in a calendar year before the year for which the CAIR NO_x Ozone Season allowance was allocated.

(4) CAIR NO_x Ozone Season allowances shall be held in, deducted from, or transferred into or among CAIR NO_x Ozone Season Allowance Tracking System accounts in accordance with subparts FFFF, GGGG, and IIII of 40 CFR part 96.

(5) A CAIR NO_x allowance is a limited authorization to emit one ton of nitrogen oxides in accordance with the CAIR NO_x Ozone Season Trading Program. No provision of the CAIR NO_x Ozone Season Trading Program, the CAIR permit application, the CAIR permit, or an exemption under §96.305 and no provision of law shall be construed to limit the authority of the State or the United States to terminate or limit such authorization.

(6) A CAIR NO_x allowance does not constitute a property right.

(7) Upon recordation by the Administrator under subpart EEEE, FFFF, GGGG, or IIII of 40 CFR part 96, every allocation, transfer, or deduction of a CAIR NO_x Ozone Season allowance to or from a CAIR NO_x Ozone Season source's compliance account is incorporated automatically in any CAIR permit of the source.

Plant Name (from Step 1) Burlington Generating Station

**STEP 3,
continued**

(d) Excess emissions requirements.

If a CAIR NO_x source emits nitrogen oxides during any control period in excess of the CAIR NO_x emissions limitation, then:

(1) The owners and operators of the source and each CAIR NO_x unit at the source shall surrender the CAIR NO_x allowances required for deduction under §96.154(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable State law; and

(2) Each ton of such excess emissions and each day of such control period shall constitute a separate violation of this subpart, the Clean Air Act, and applicable State law.

If a CAIR SO₂ source emits sulfur dioxide during any control period in excess of the CAIR SO₂ emissions limitation, then:

(1) The owners and operators of the source and each CAIR SO₂ unit at the source shall surrender the CAIR SO₂ allowances required for deduction under §96.254(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable State law; and

(2) Each ton of such excess emissions and each day of such control period shall constitute a separate violation of this subpart, the Clean Air Act, and applicable State law.

If a CAIR NO_x Ozone Season source emits nitrogen oxides during any control period in excess of the CAIR NO_x Ozone Season emissions limitation, then:

(1) The owners and operators of the source and each CAIR NO_x Ozone Season unit at the source shall surrender the CAIR NO_x Ozone Season allowances required for deduction under §96.354(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable State law; and

(2) Each ton of such excess emissions and each day of such control period shall constitute a separate violation of this subpart, the Clean Air Act, and applicable State law.

(e) Recordkeeping and Reporting Requirements.

(1) Unless otherwise provided, the owners and operators of the CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) and each CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time before the end of 5 years, in writing by the permitting authority or the Administrator.

(i) The certificate of representation under §96.113, §96.213, and §96.313 (as applicable) for the CAIR designated representative for the source and each CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) at the source and all documents that demonstrate the truth of the statements in the certificate of representation; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation under §96.113, §96.213, and §96.313 (as applicable) changing the CAIR designated representative.

(ii) All emissions monitoring information, in accordance with subparts HH, HHH, and HHHH (as applicable) of 40 CFR part 96, provided that to the extent that subparts HH, HHH, and HHHH (as applicable) of 40 CFR part 96 provides for a 3-year period for recordkeeping, the 3-year period shall apply.

(iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable).

(iv) Copies of all documents used to complete a CAIR permit application and any other submission under the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable) or to demonstrate compliance with the requirements of the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable).

(2) The CAIR designated representative of a CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) and each CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) at the source shall submit the reports required under the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable) including those under subparts HH, HHH, and HHHH (as applicable) of 40 CFR part 96.

(f) Liability.

(1) Each CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) and each NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) shall meet the requirements of the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable).

(2) Any provision of the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable) that applies to a CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) or the CAIR designated representative of a CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) shall also apply to the owners and operators of such source and of the CAIR NO_x units, CAIR SO₂ units, and CAIR NO_x Ozone Season units (as applicable) at the source.

(3) Any provision of the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable) that applies to a CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) or the CAIR designated representative of a CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) shall also apply to the owners and operators of such unit.

Plant Name (from Step 1) **Burlington Generating Station**

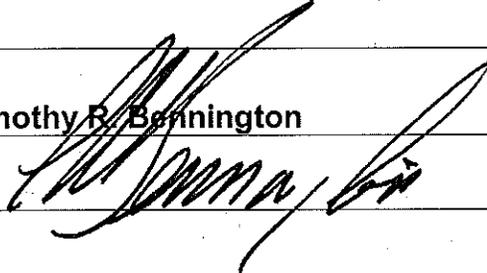
**STEP 3,
continued**

(g) Effect on Other Authorities.

No provision of the CAIR NO_x Annual Trading Program, CAIR SO₂ Trading Program, and CAIR NO_x Ozone Season Trading Program (as applicable), a CAIR permit application, a CAIR permit, or an exemption under § 96.105, §96.205, and §96.305 (as applicable) shall be construed as exempting or excluding the owners and operators, and the CAIR designated representative, of a CAIR NO_x source, CAIR SO₂ source, and CAIR NO_x Ozone Season source (as applicable) or CAIR NO_x unit, CAIR SO₂ unit, and CAIR NO_x Ozone Season unit (as applicable) from compliance with any other provision of the applicable, approved State implementation plan, a federally enforceable permit, or the Clean Air Act.

Certification

I am authorized to make this submission on behalf of the owners and operators of the source or units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name Timothy R. Bennington	
Signature 	Date 6/20/07